

Measured Data

QC Limits

Line	Parameter	Value	Units
1	RMSE-free	0.25	Ohms
2	Fs	40.81	Hz
3	Re	3.81	Ohms[dc]
4	Res	14.58	Ohms
5	Qms	5.83	
6	Qes	1.52	
7	Qts	1.21	
8	L1	0.42	mH
9	L2	0.75	mH
10	R2	4.66	Ohms
11	RMSE-load	0.39	Ohms
12	Vas(Sd)	92.16	liters
13	Mms	60.47	grams
14	Cms	252	$\mu\text{M}/\text{Newton}$
15	B1	6.23	Tesla-M
16	SPLref(Sd)	88.0	dB[Re]
17	Rub-index	0.01	

Method: Mass-loaded (80.00 grams)

Area (Sd): 510.71 sq cm


DCR mode: Measure (-0.07 ohms)

QC file: CLOSED

Analysis successful. Shift in Fs = -30.5% (-20% to -50% is recommended).


CALIBER CW-120S

MLSSA: Parameters

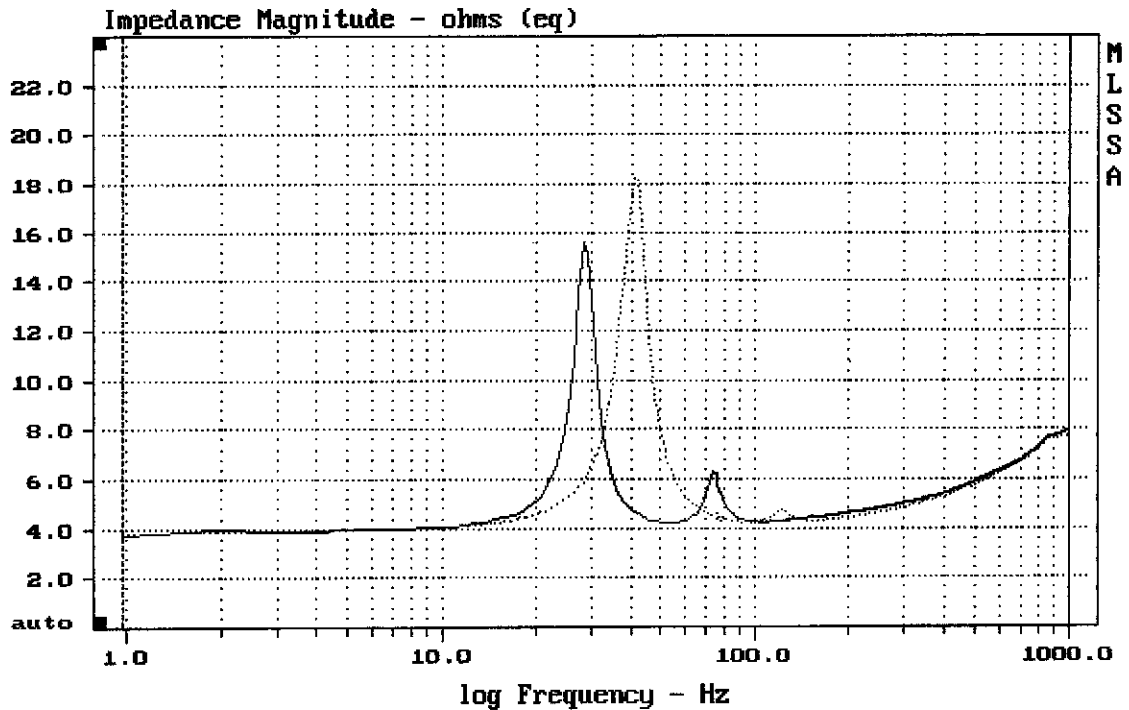

mean: 6.053, rms: 6.246, std: 1.538, max: 18.33, min: 3.84


MLSSA: Frequency Domain

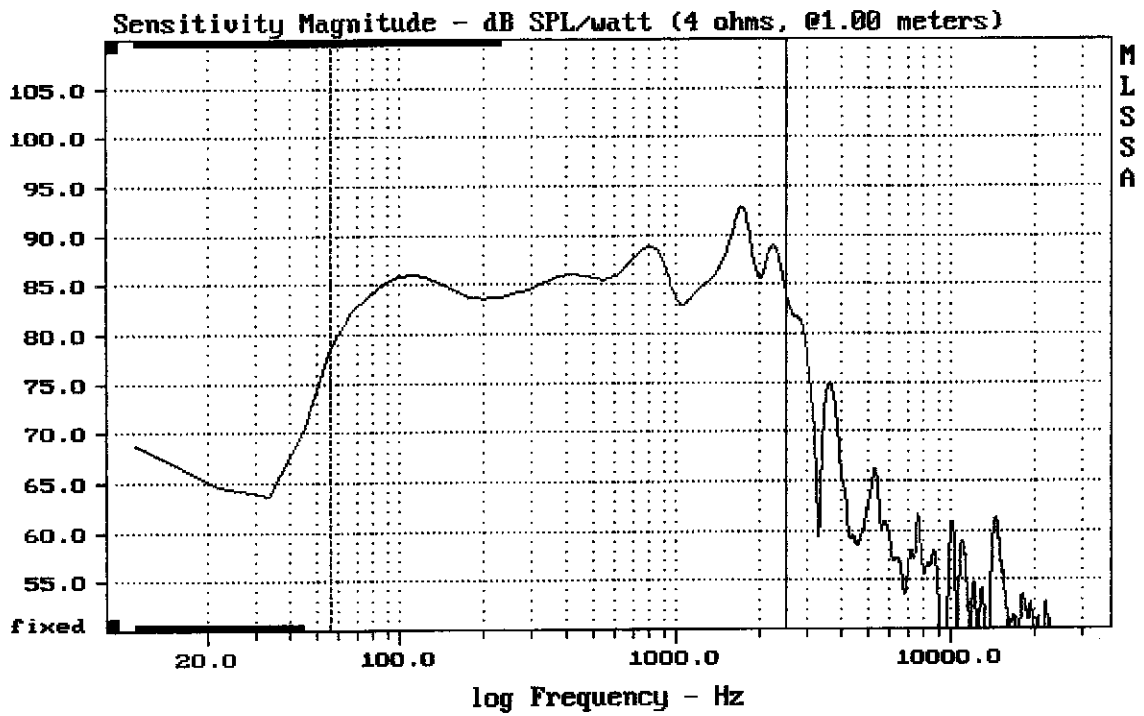

Level (55:2508 Hz) = 86.05 dB SPL/watt (4 ohms, @1.00 meters)

CALIBER CW-120S

MLSSA: Frequency Domain

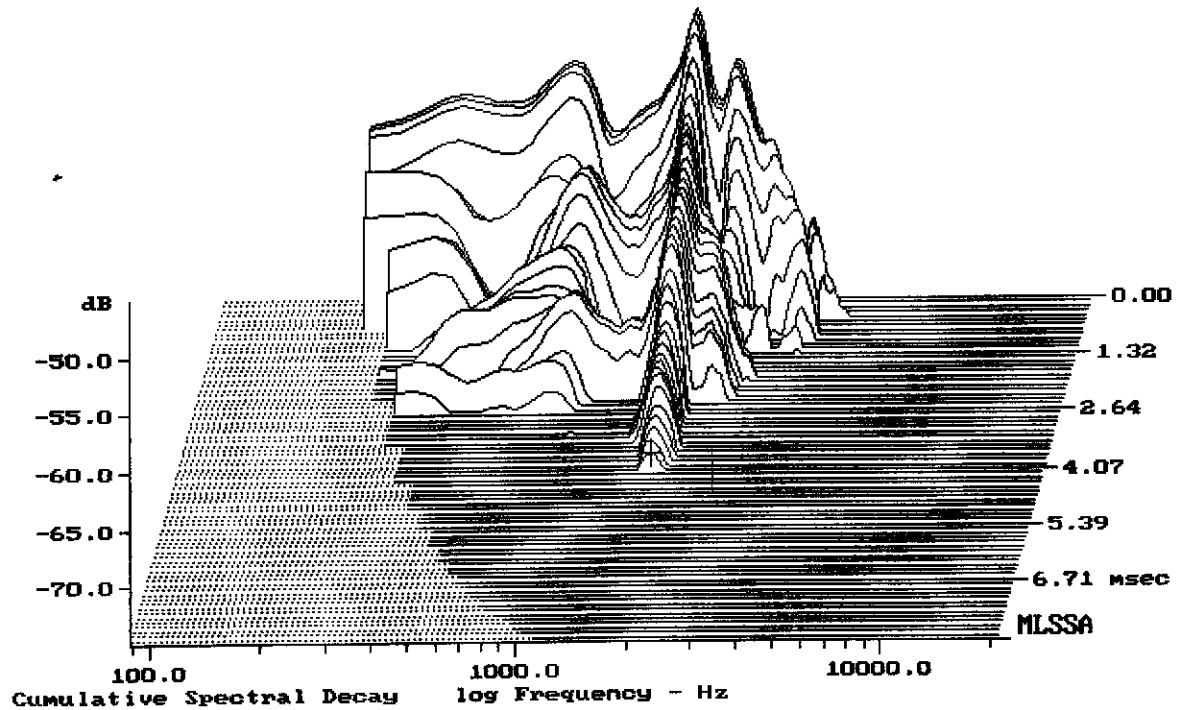

-73.43 dB, 1731 Hz (39), 4.070 msec (38)