


LEVEL  
02.07.2011  
00:55:49

Output: Analog  
Imp: <150hm  
Sine  
0.01dBV 40.00 Hz

Input: Analog  
Imp:100kOhm  
A: 0.21dBV 39.99 Hz

Filter:  
Off

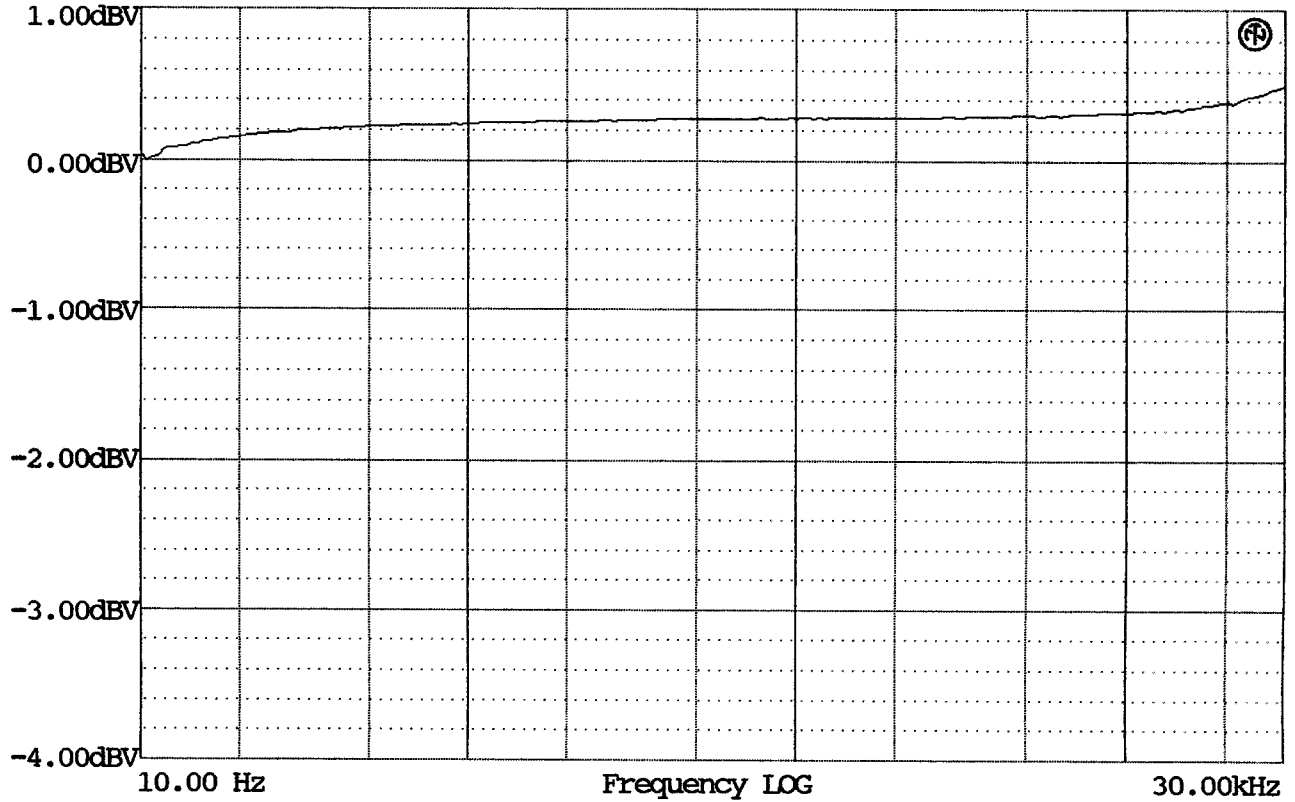


THD+N  
02.07.2011  
01:01:30

Output: Analog  
Imp: <150hm  
Sine  
0.01dBV 40.00 Hz

Input: Analog  
Imp:100kOhm  
A: 0.21dBV 39.99 Hz

Filter:  
AUDIOBP

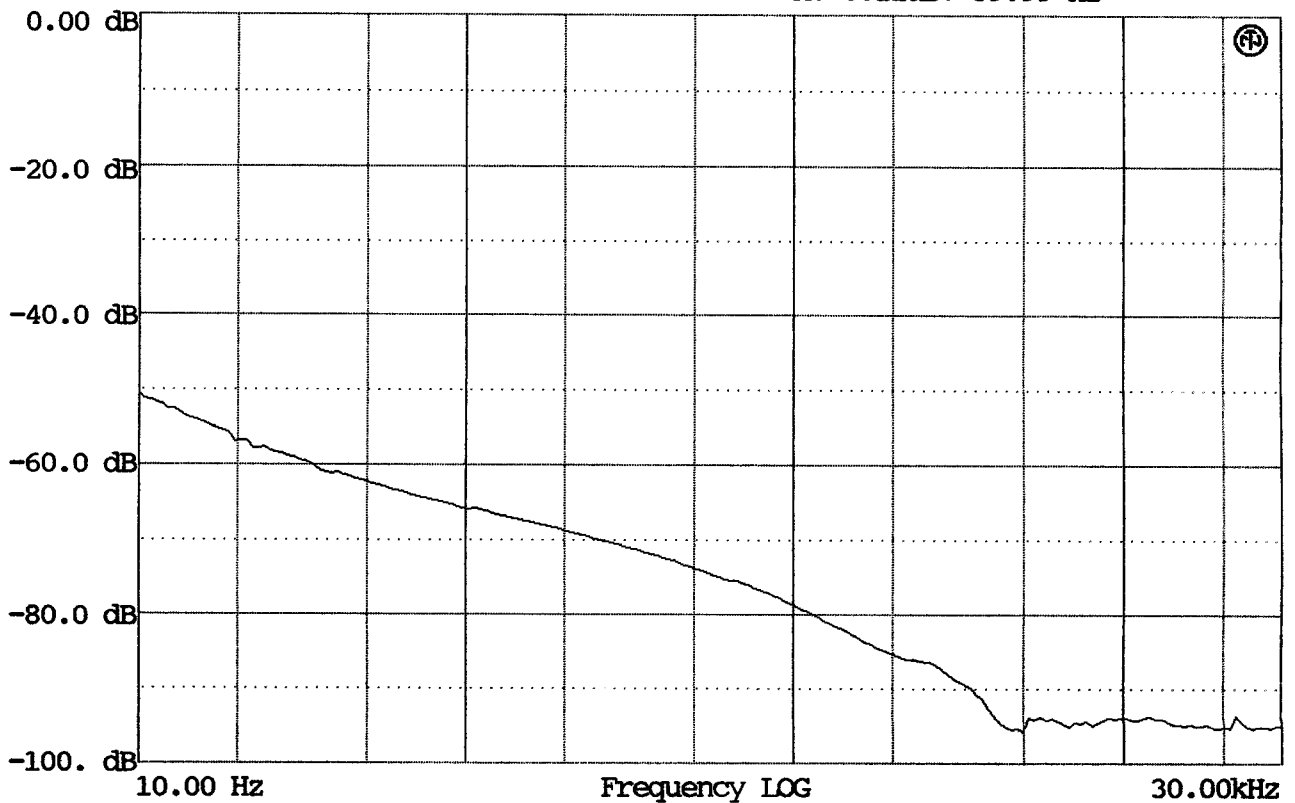

LL 1539


LEVEL  
02.07.2011  
01:03:09

Output: Analog  
Imp: 2000hm  
Sine  
0.01dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

A: -0.09dBV 39.99 Hz

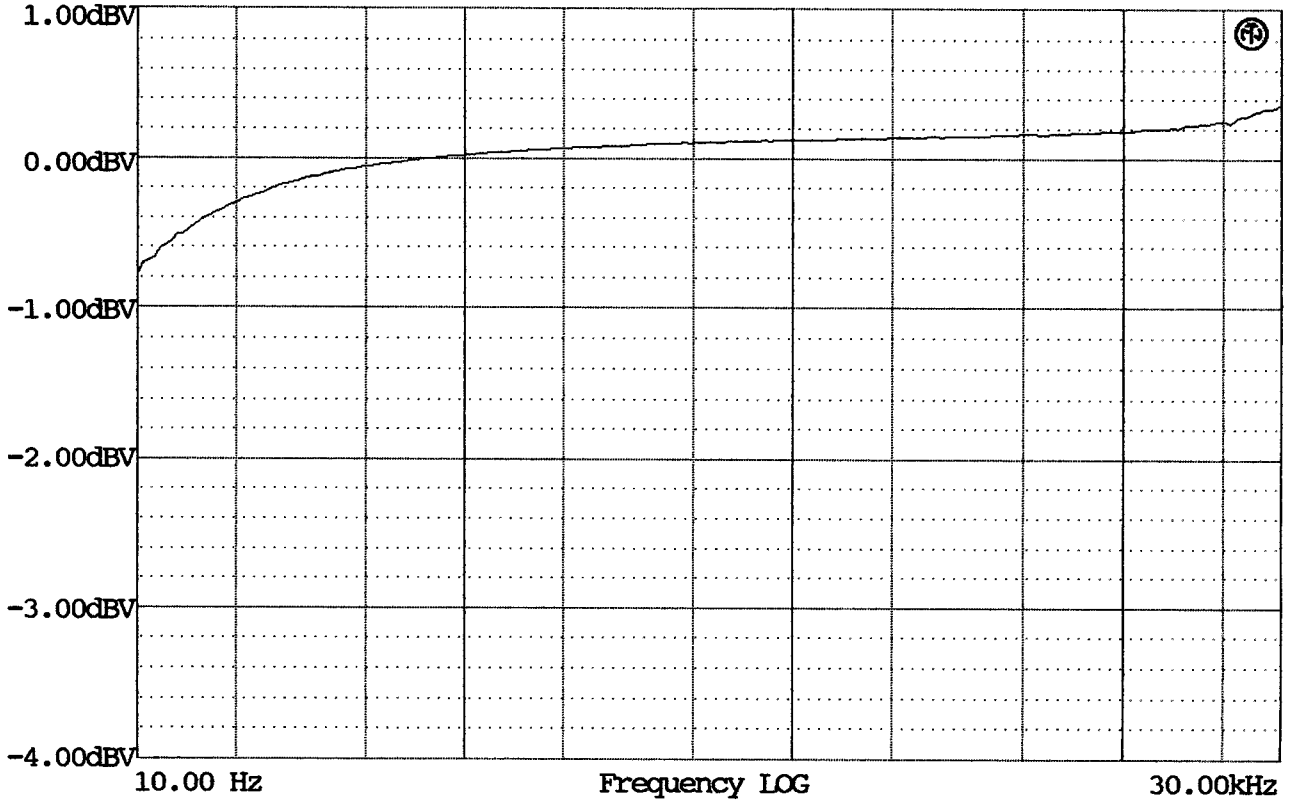


THD+N  
02.07.2011  
01:08:35

Output: Analog  
Imp: 2000hm  
Sine  
0.01dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
AUDIOBP

A: -0.08dBV 39.99 Hz

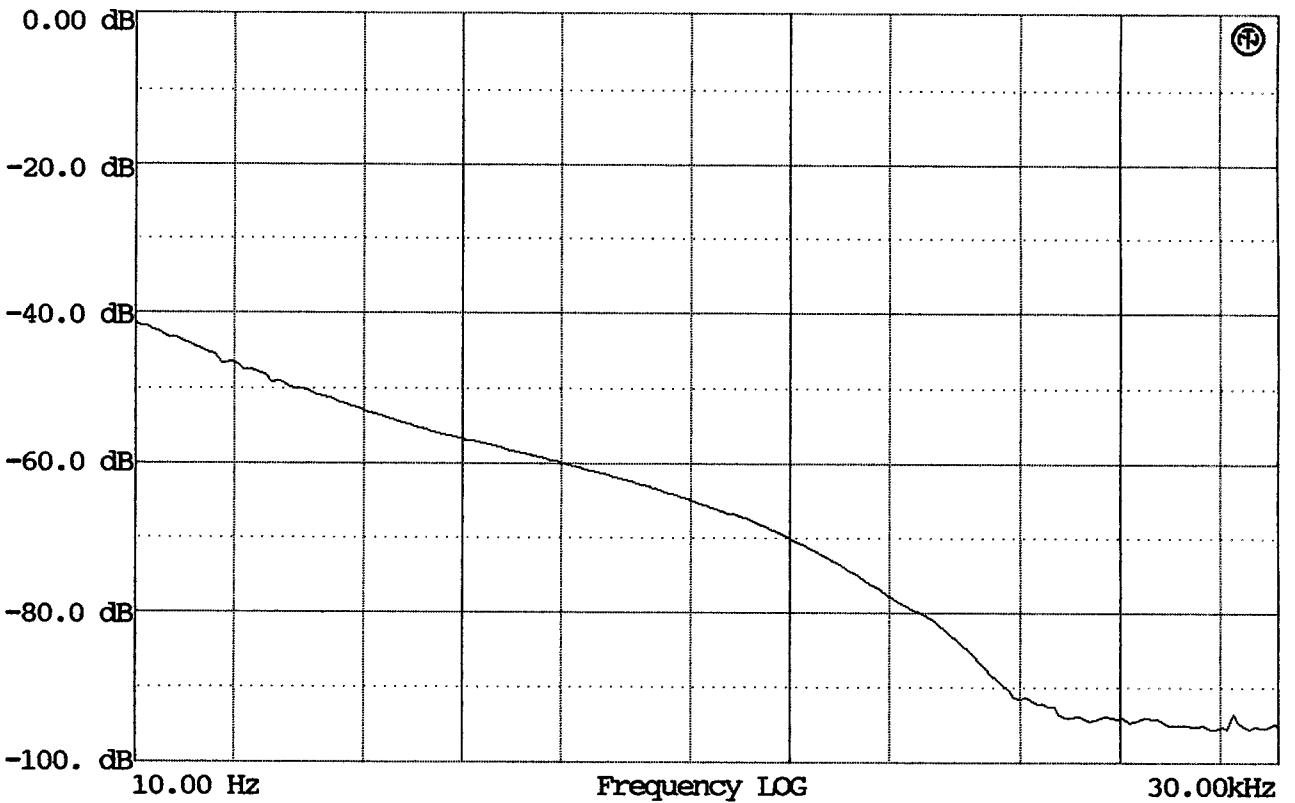

LL 1539


**LEVEL**  
02.07.2011  
00:48:36

Output: Analog  
Imp: 6000hm  
Sine  
0.01dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
Off

A: -0.81dBV 39.99 Hz

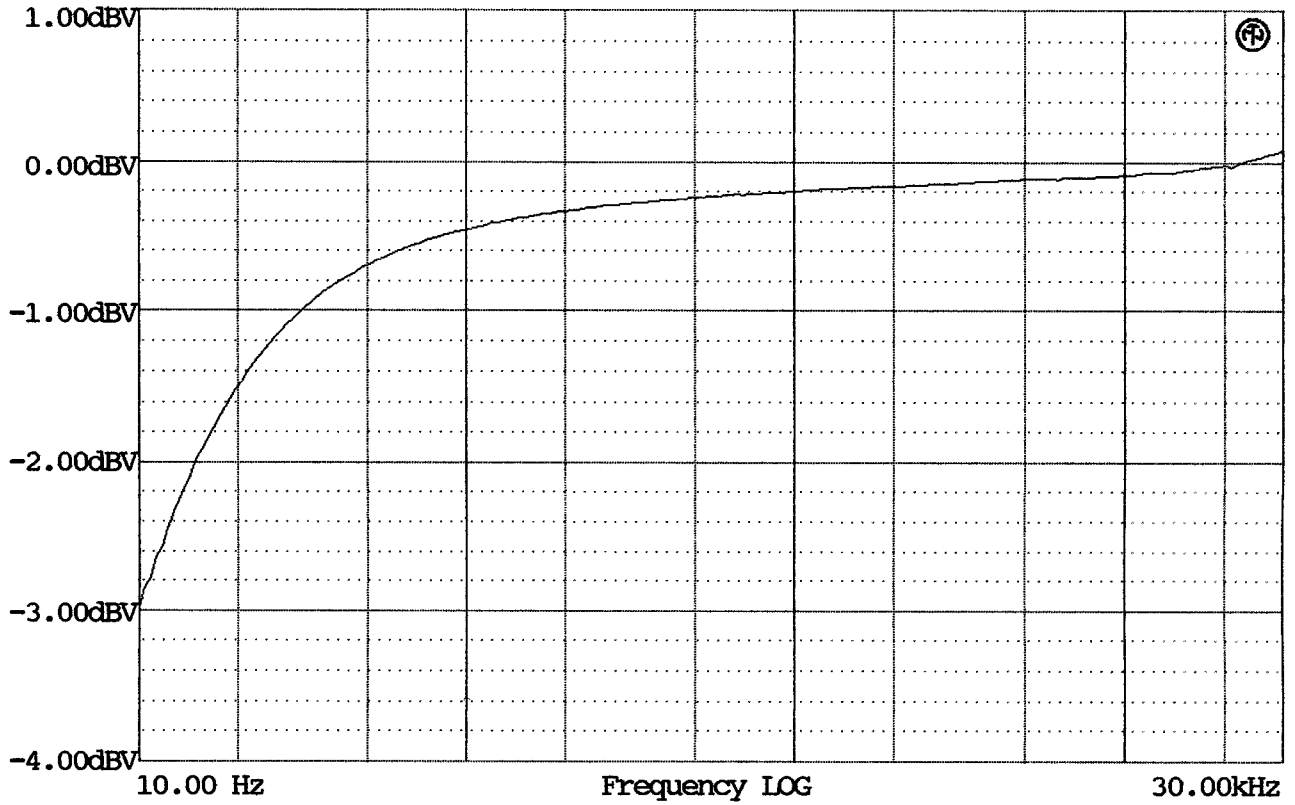


**THD+N**  
02.07.2011  
00:54:04

Output: Analog  
Imp: 6000hm  
Sine  
0.01dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
AUDIOBP

A: -0.80dBV 39.99 Hz

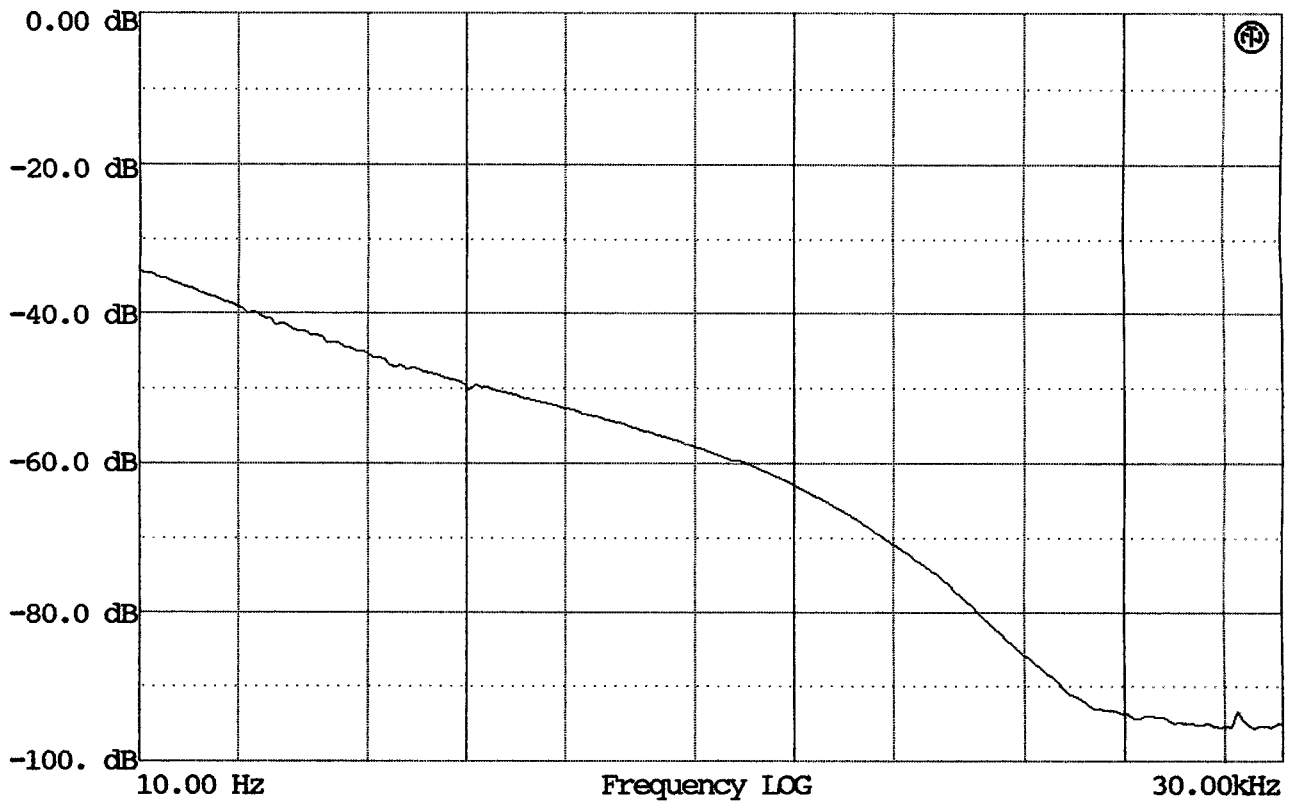


THD+N  
02.07.2011  
01:15:15

Output: Analog  
Imp: 2000hm  
Sine  
-10.0dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
AUDIOBP

A: -10.1dBV 39.99 Hz

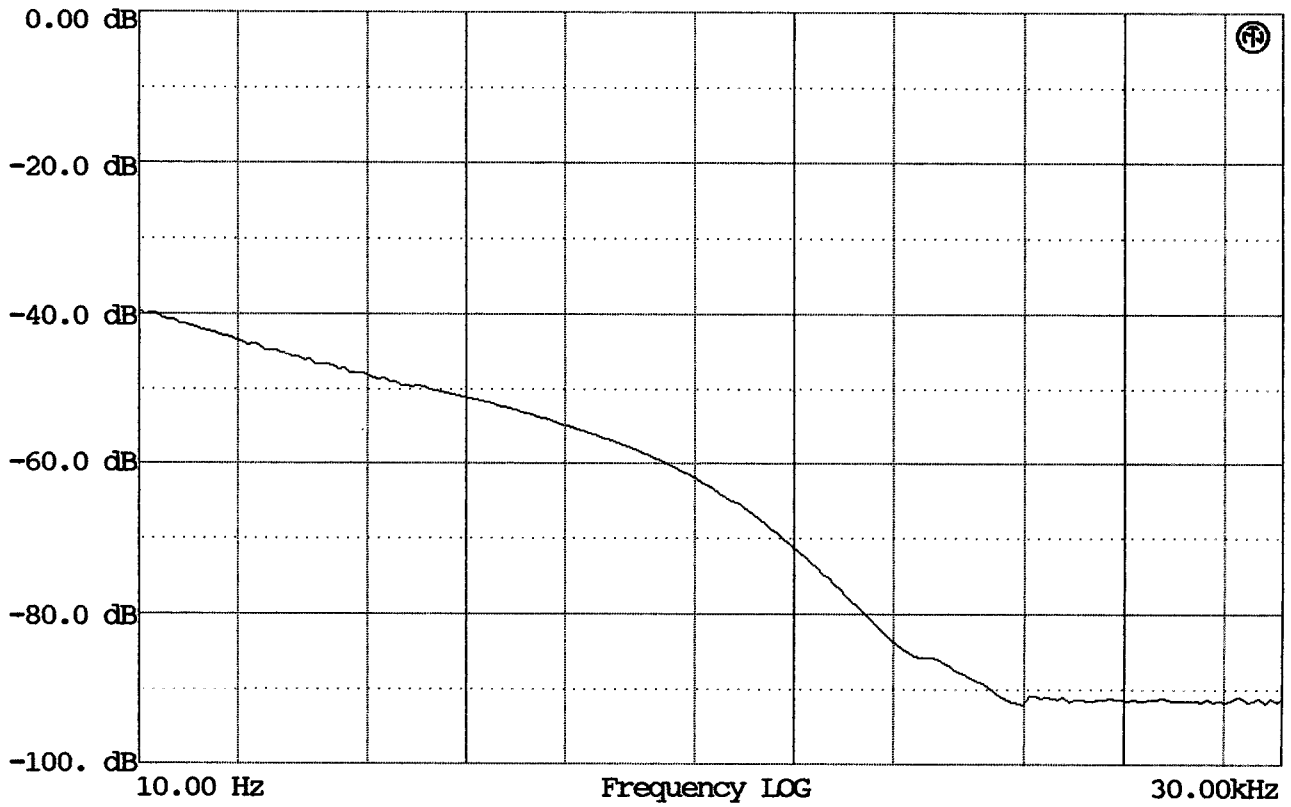


THD+N  
02.07.2011  
01:21:10

Output: Analog  
Imp: 6000hm  
Sine  
-10.0dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
AUDIOBP

A: -11.0dBV 39.99 Hz

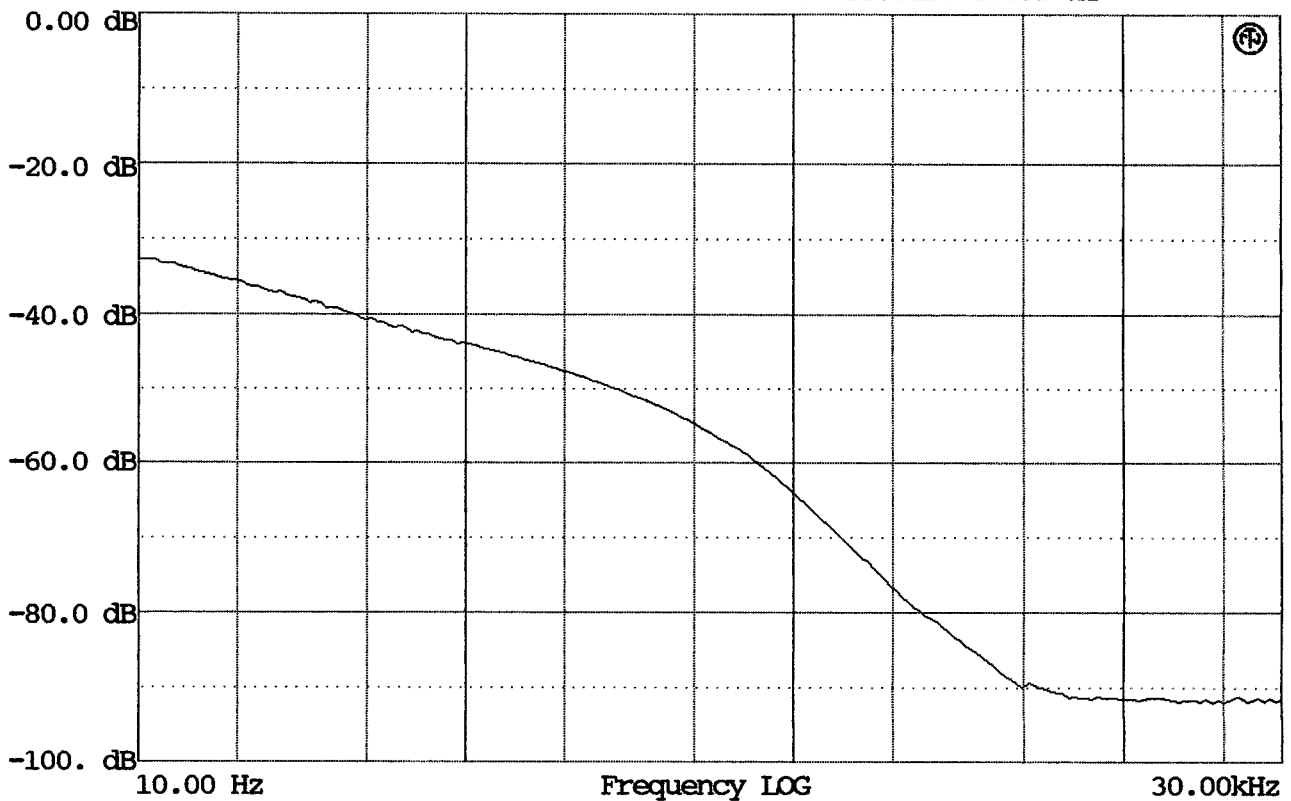

LL 1539


THD+N  
02.07.2011  
01:27:12

Output: Analog  
Imp: <150hm  
Sine  
-10.0dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
AUDIOBP

A: -9.84dBV 39.99 Hz

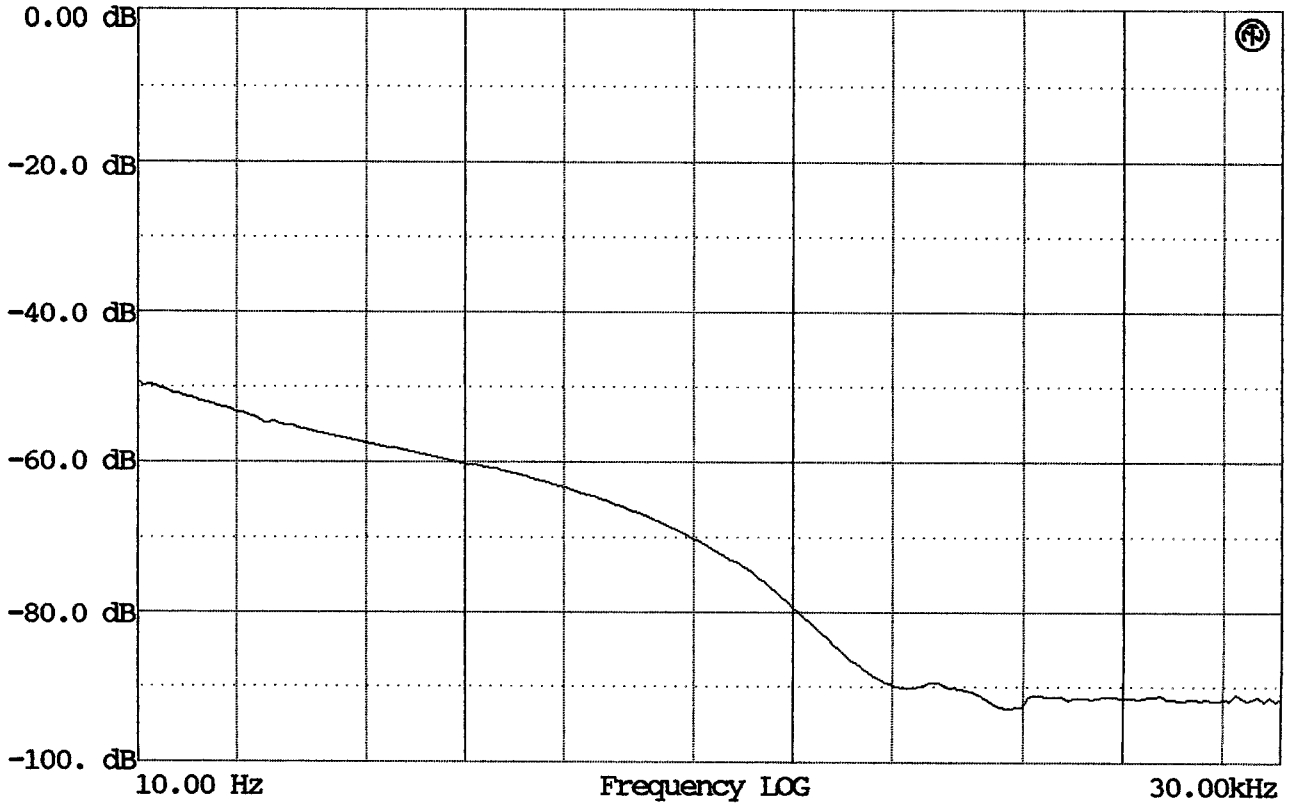


THD+N  
02.07.2011  
01:33:13

Output: Analog  
Imp: <150hm  
Sine  
20.0dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
Off

A: 20.2dBV 39.99 Hz

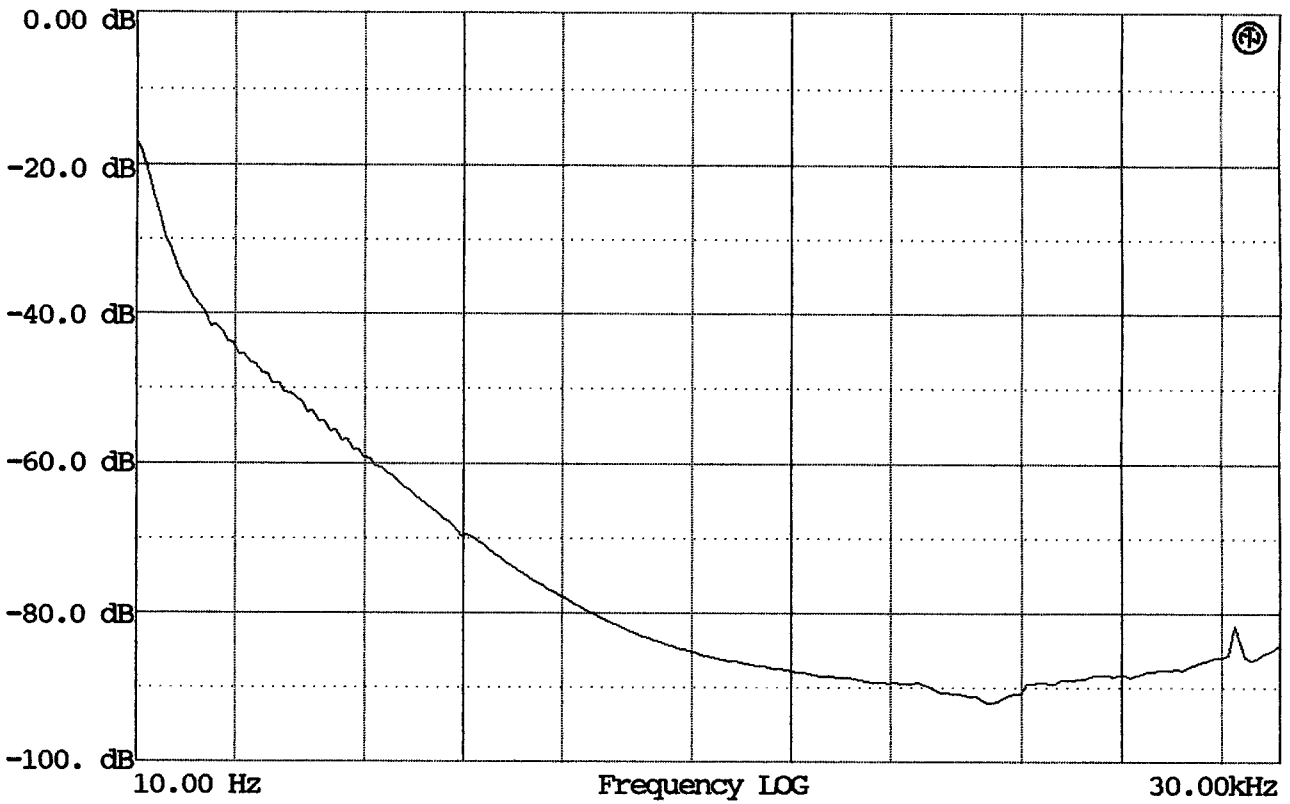

66 1529


THD+N  
02.07.2011  
01:39:46

Output: Analog  
Imp: 200Ohm  
Sine  
20.0dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
Off

A: 20.0dBV 39.99 Hz

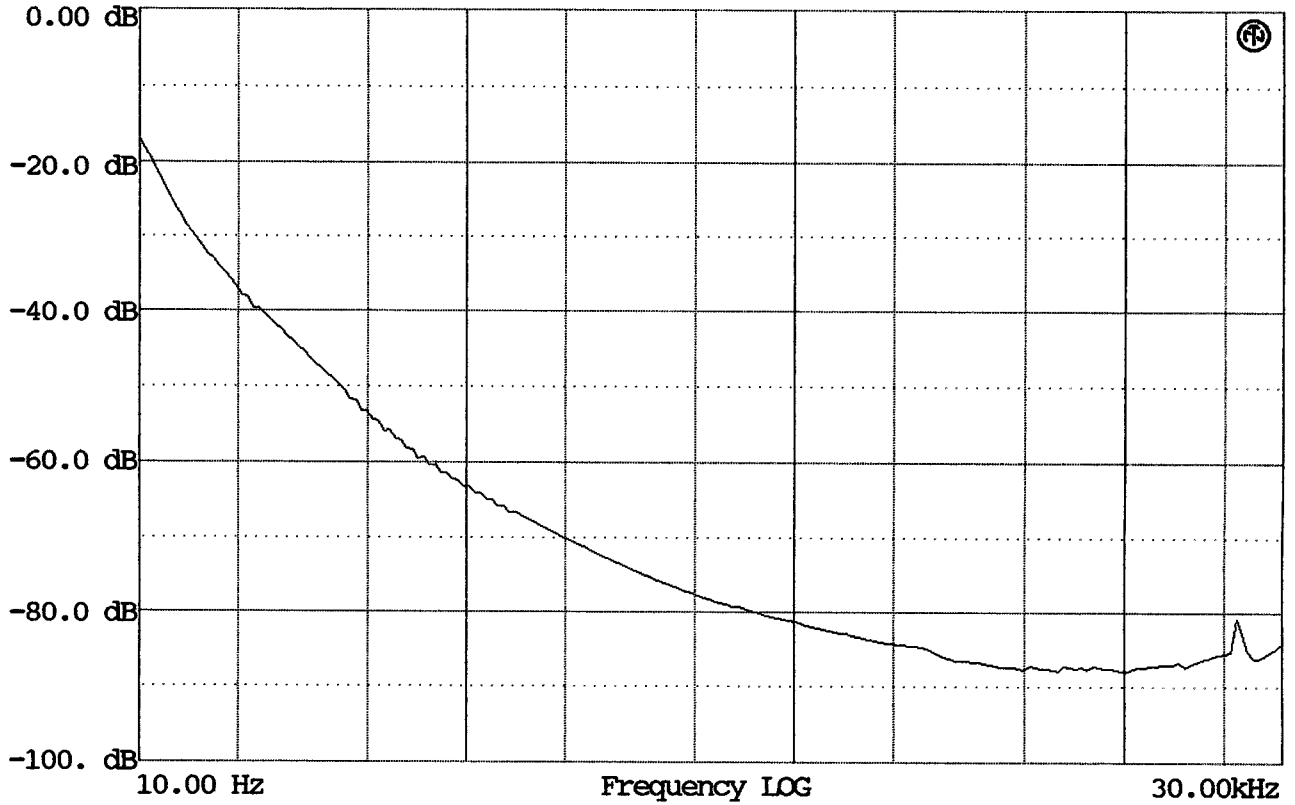


THD+N  
02.07.2011  
01:47:23

Output: Analog  
Imp: 600Ohm  
Sine  
20.0dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
Off

A: 19.5dBV 39.99 Hz

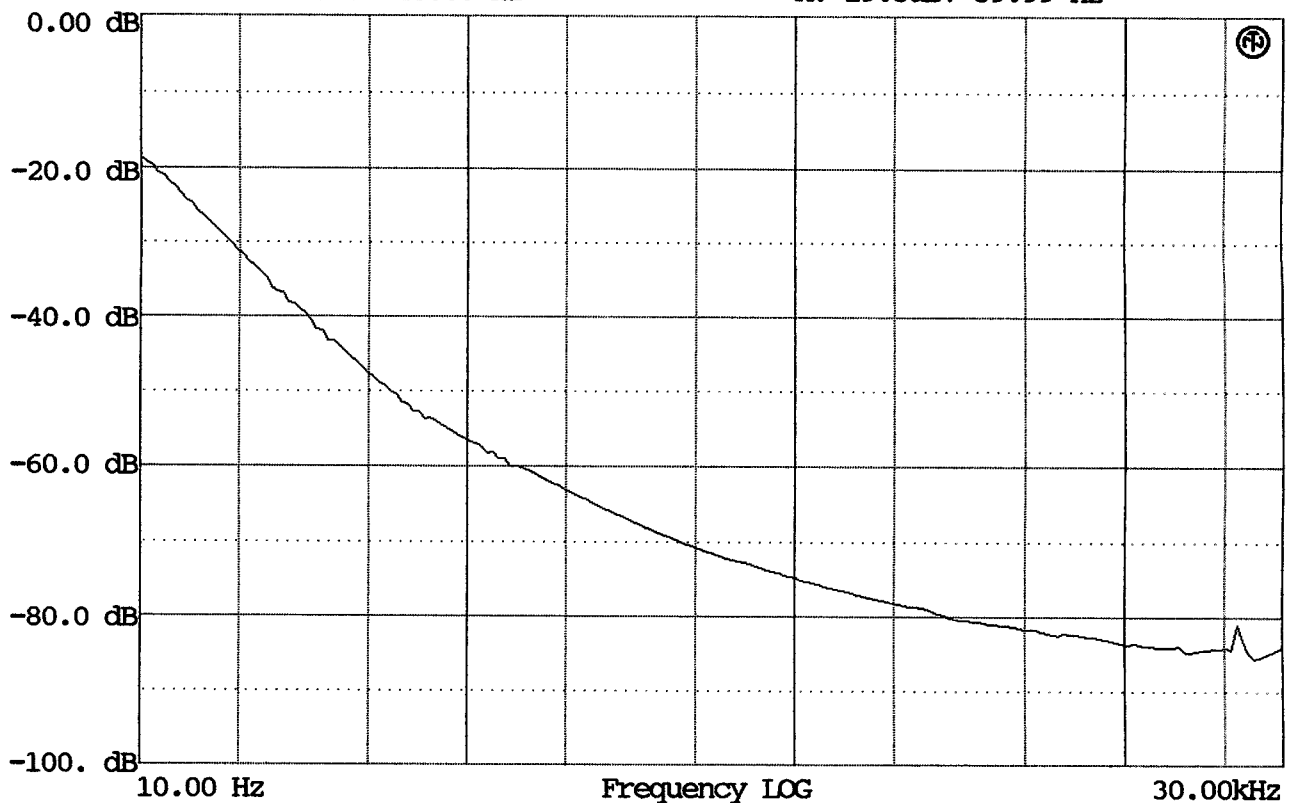


LL 1539

LEVEL  
02.07.2011  
01:51:37

Output: Analog  
Imp: <150hm  
Sine  
26.0dBV 40.00 Hz

Input: Analog  
Imp:100kOhm  
A: 26.2dBV 39.99 Hz

Filter:  
Off

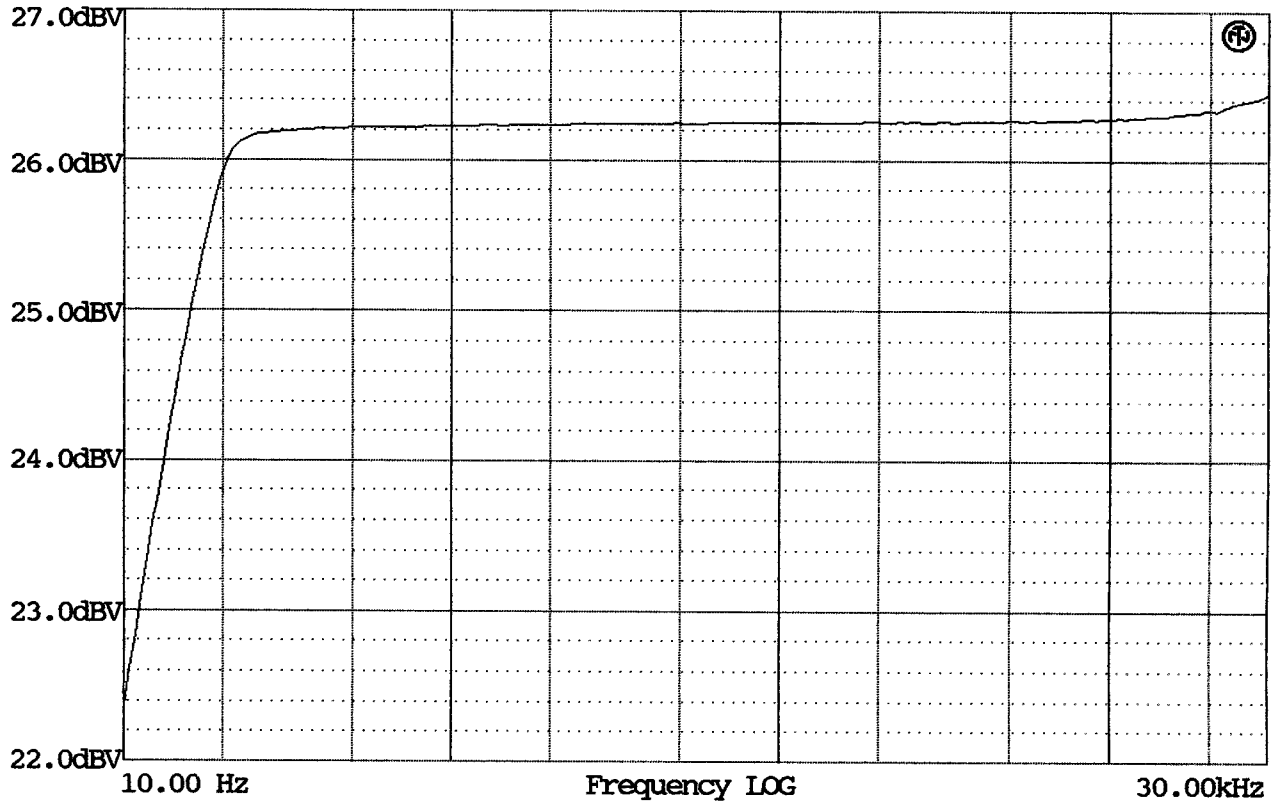


THD+N  
02.07.2011  
02:01:09

Output: Analog  
Imp: <150hm  
Sine  
26.0dBV 40.00 Hz

Input: Analog  
Imp:100kOhm  
A: 26.2dBV 39.99 Hz

Filter:  
Off

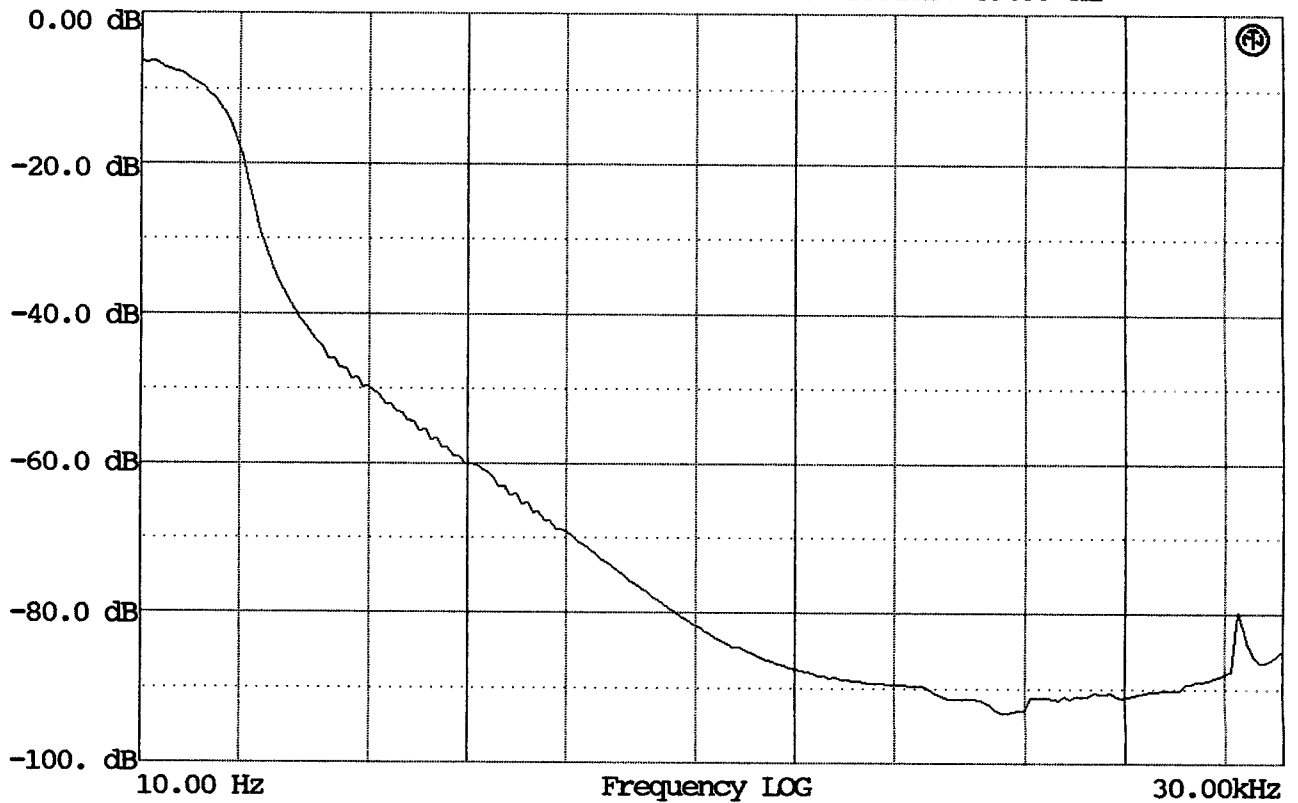

LL 1539