


**LEVEL**  
03.07.2011  
02:06:13

Output: Analog  
Imp: <150hm  
Sine  
0.00dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
Off

A: -0.14dBV 39.99 Hz

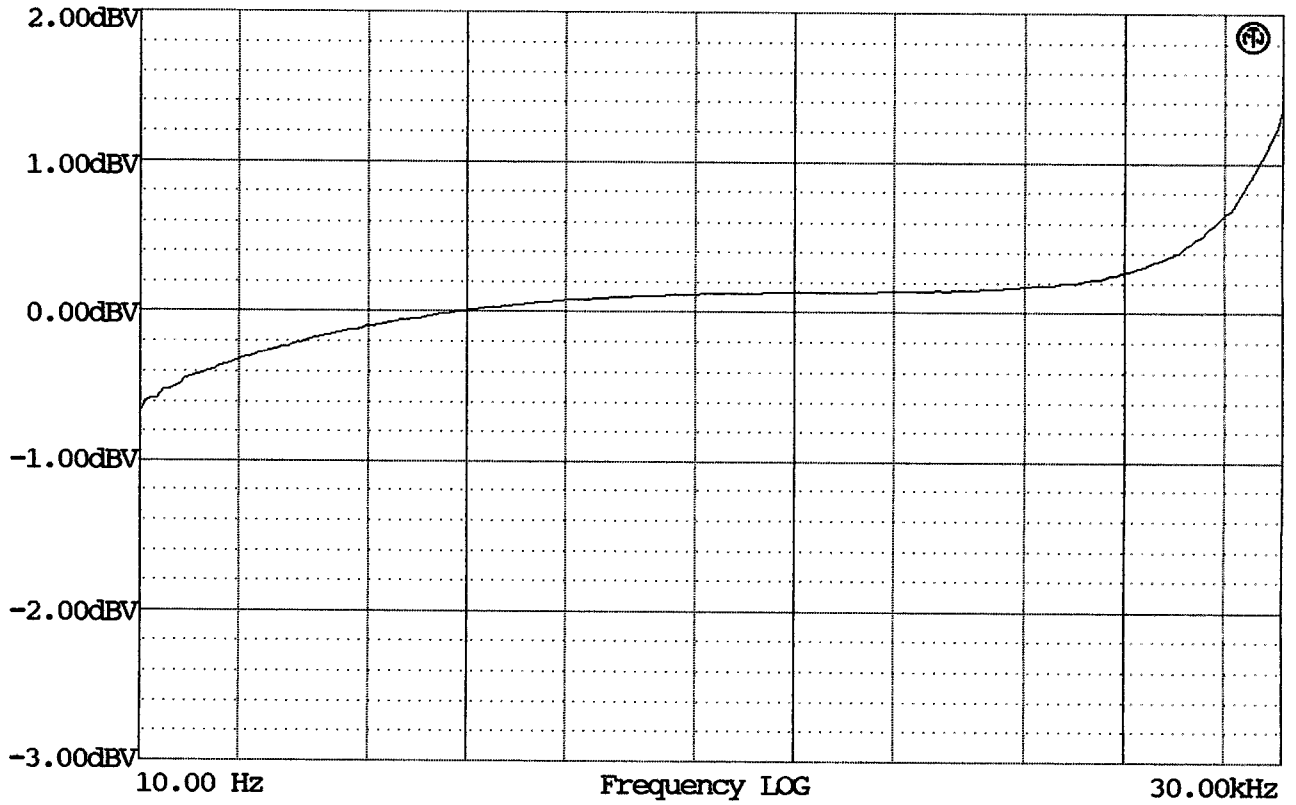


**THD+N**  
03.07.2011  
02:11:52

Output: Analog  
Imp: <150hm  
Sine  
0.00dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
Off

A: -0.14dBV 39.99 Hz

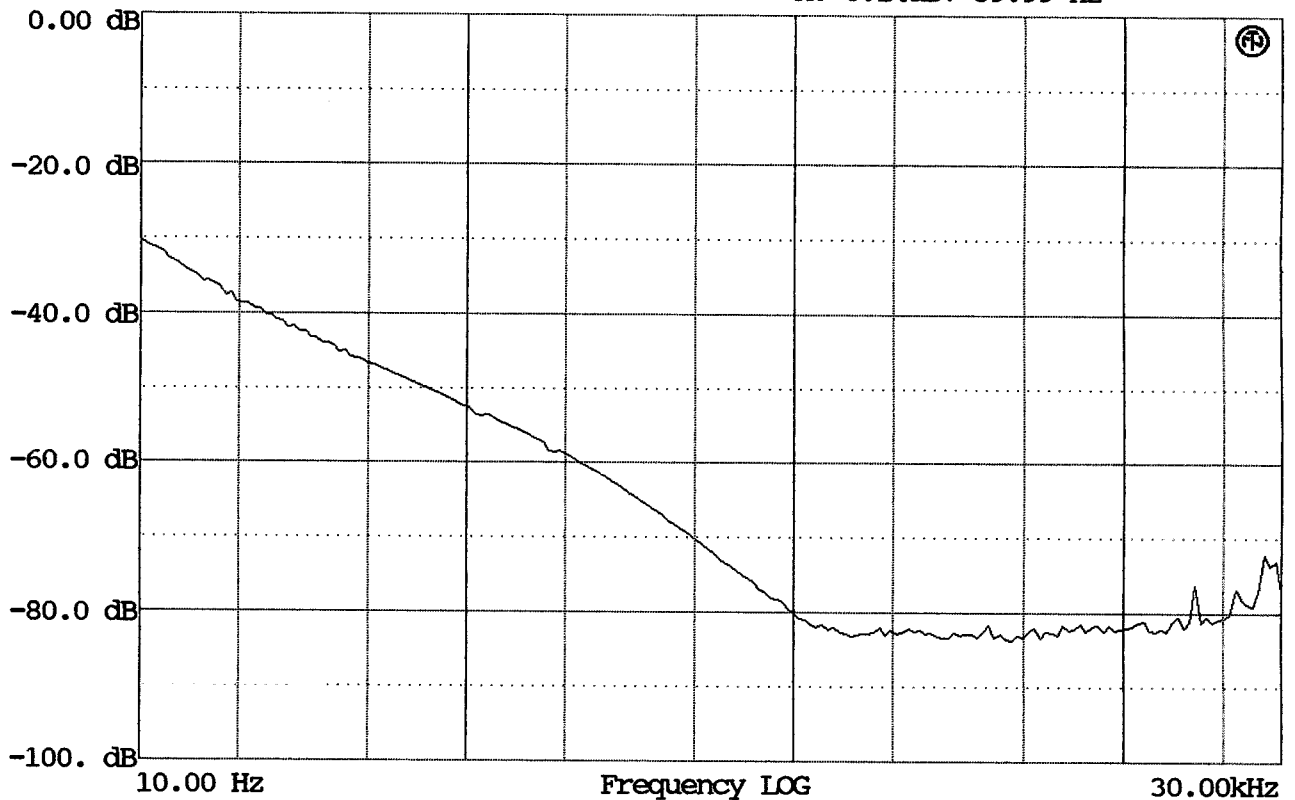


IT-421

LEVEL  
03.07.2011  
01:04:04

Output: Analog  
Imp: 200Ohm  
Sine  
0.00dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm  
A: -0.37dBV 39.99 Hz

Filter:  
Off

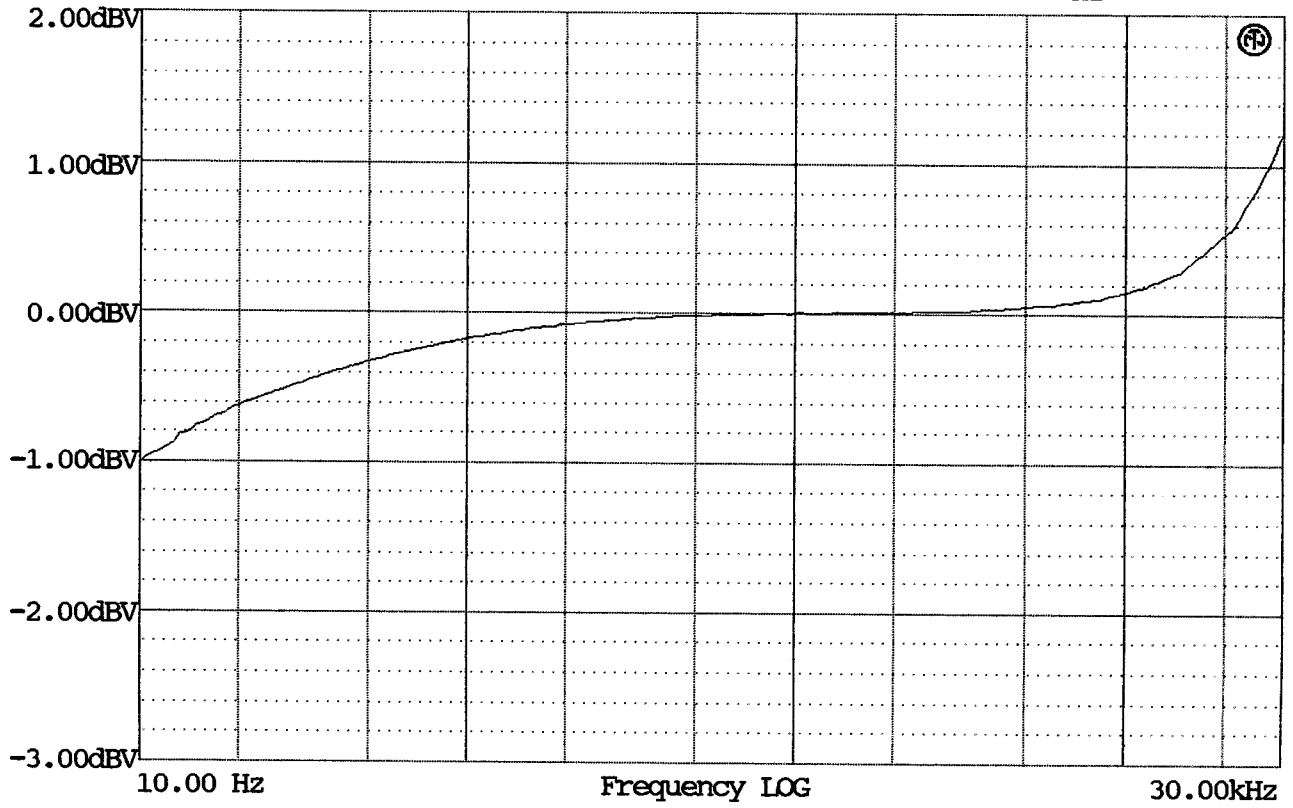


THD+N  
03.07.2011  
01:09:32

Output: Analog  
Imp: 200Ohm  
Sine  
0.00dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm  
A: -0.37dBV 39.99 Hz

Filter:  
Off

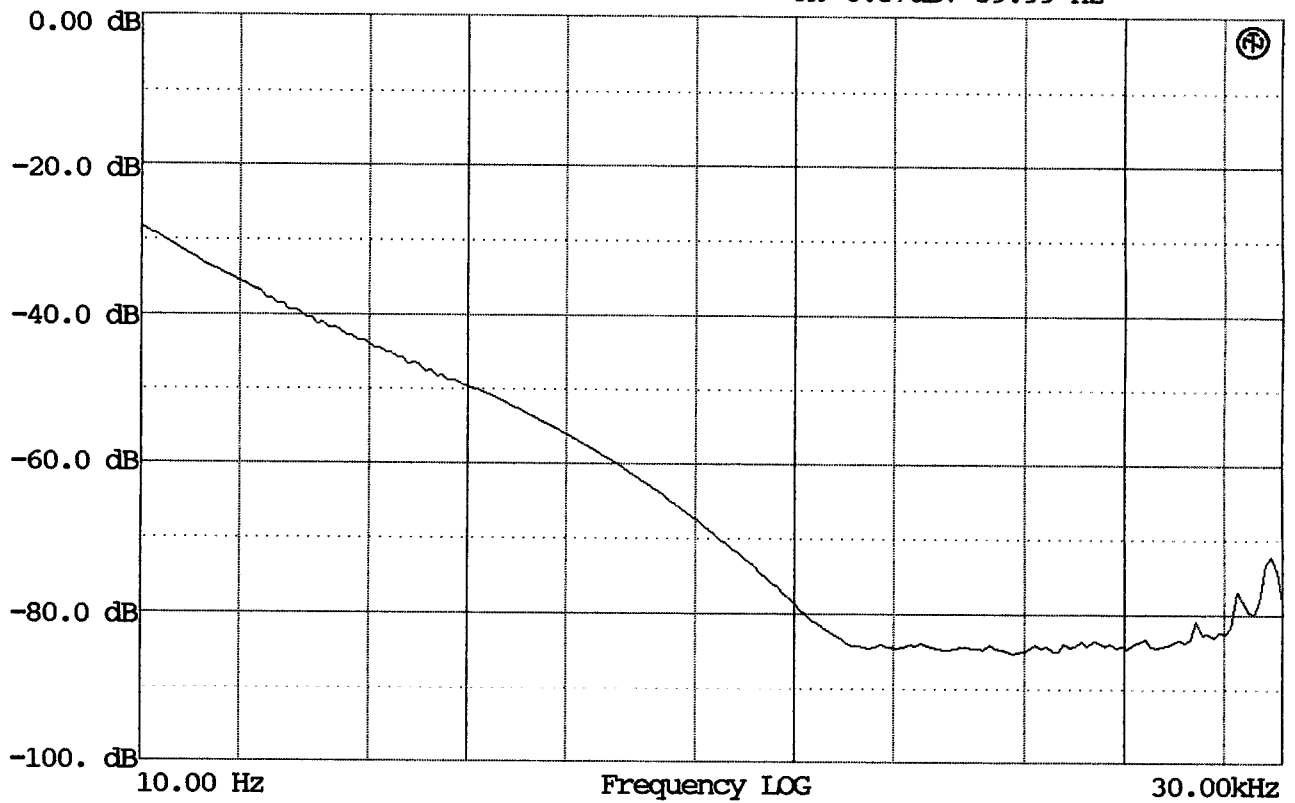


LEVEL  
03.07.2011  
01:58:00

Output: Analog  
Imp: 600Ohm  
Sine  
0.00dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

A: -0.85dBV 39.99 Hz

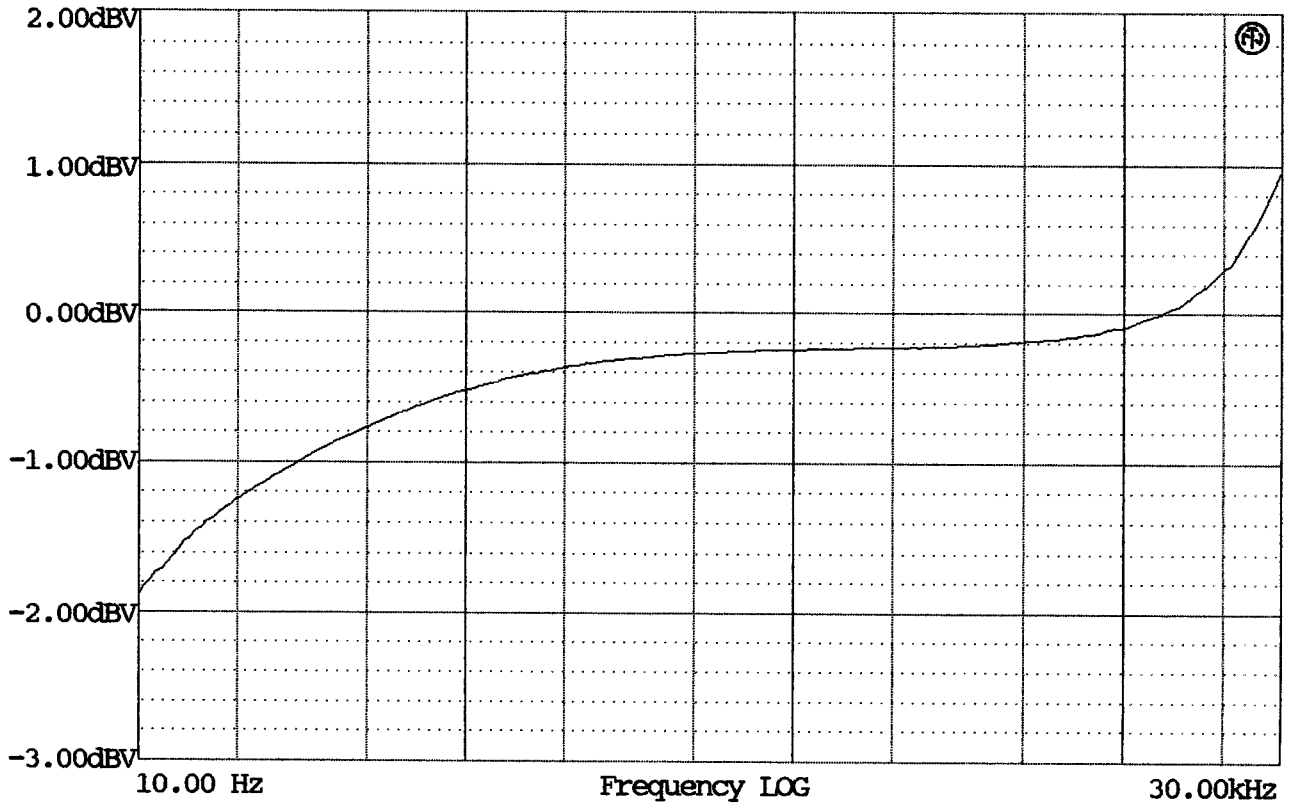


THD+N  
03.07.2011  
02:04:18

Output: Analog  
Imp: 600Ohm  
Sine  
0.00dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

A: -0.85dBV 39.99 Hz

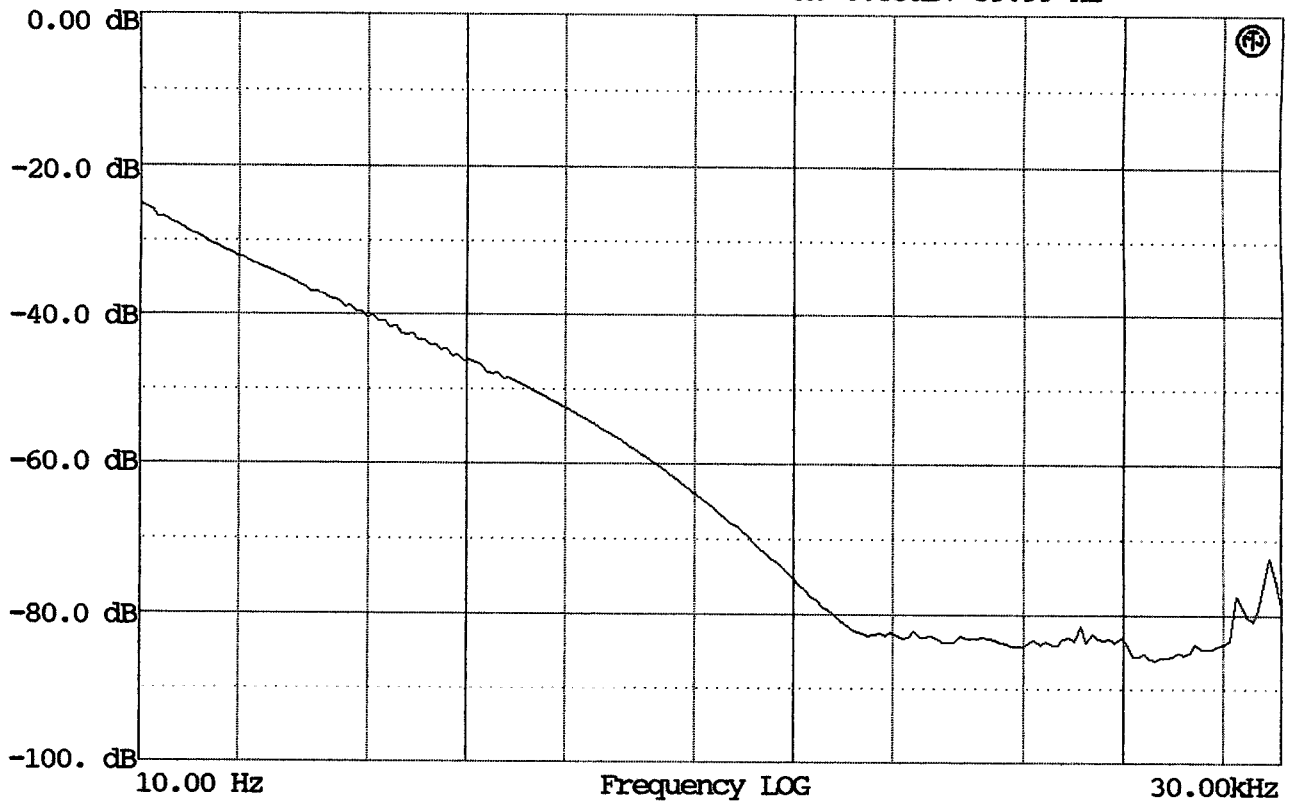


**LEVEL**  
03.07.2011  
01:19:26

Output: Analog  
Imp: 200Ohm  
Sine  
-10.0dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm  
A: -10.5dBV 39.99 Hz

Filter:  
Off

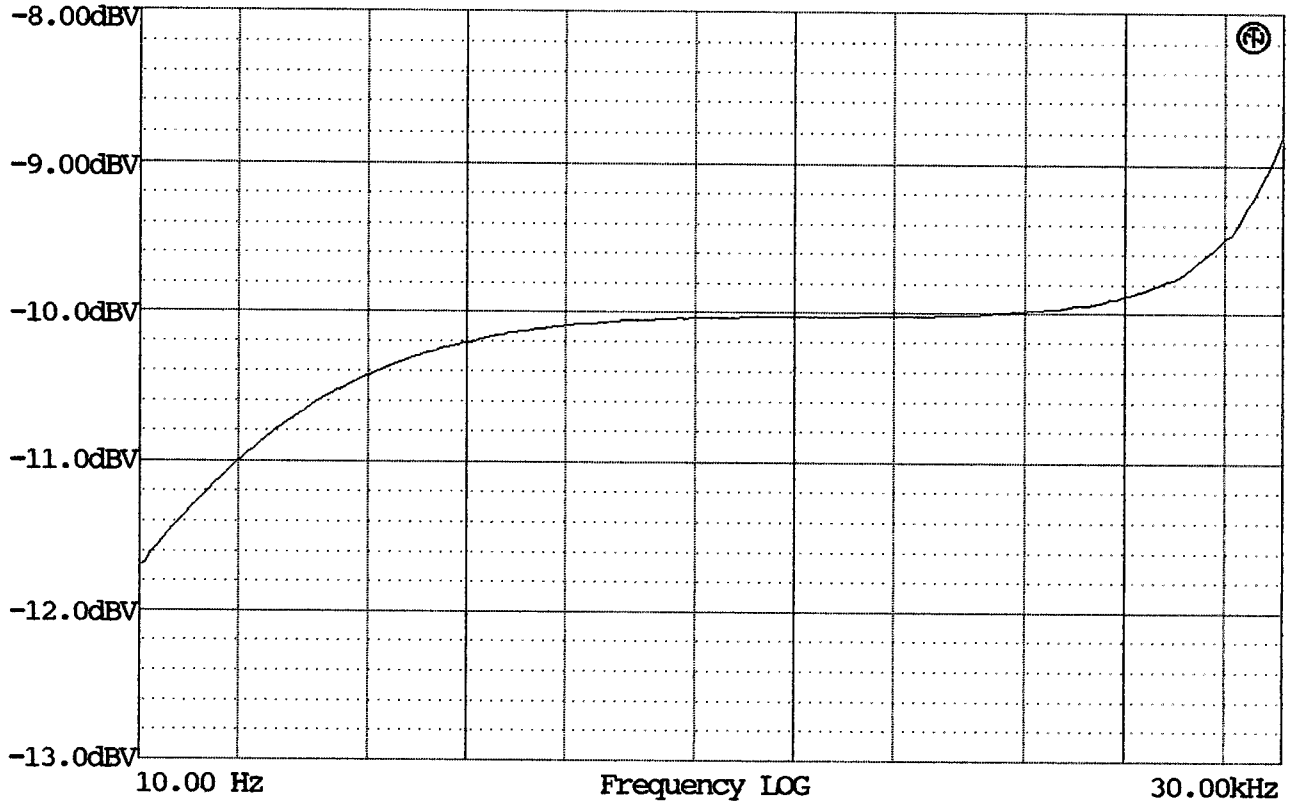


**THD+N**  
03.07.2011  
01:27:49

Output: Analog  
Imp: 200Ohm  
Sine  
-10.0dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm  
A: -10.5dBV 39.99 Hz

Filter:  
AUDIOBP

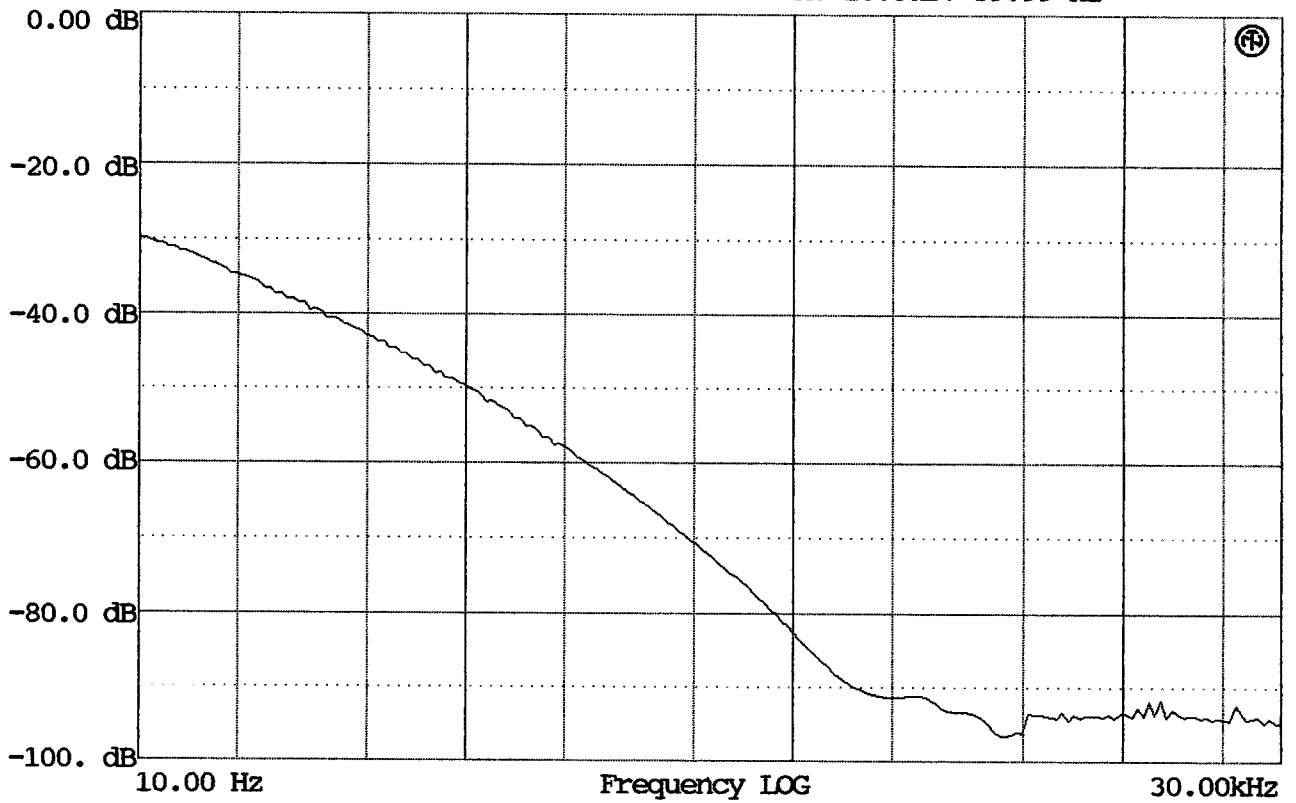


**LEVEL**  
03.07.2011  
01:11:36

Output: Analog  
Imp: 200Ohm  
Sine  
10.0dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

A: 9.76dBV 39.99 Hz

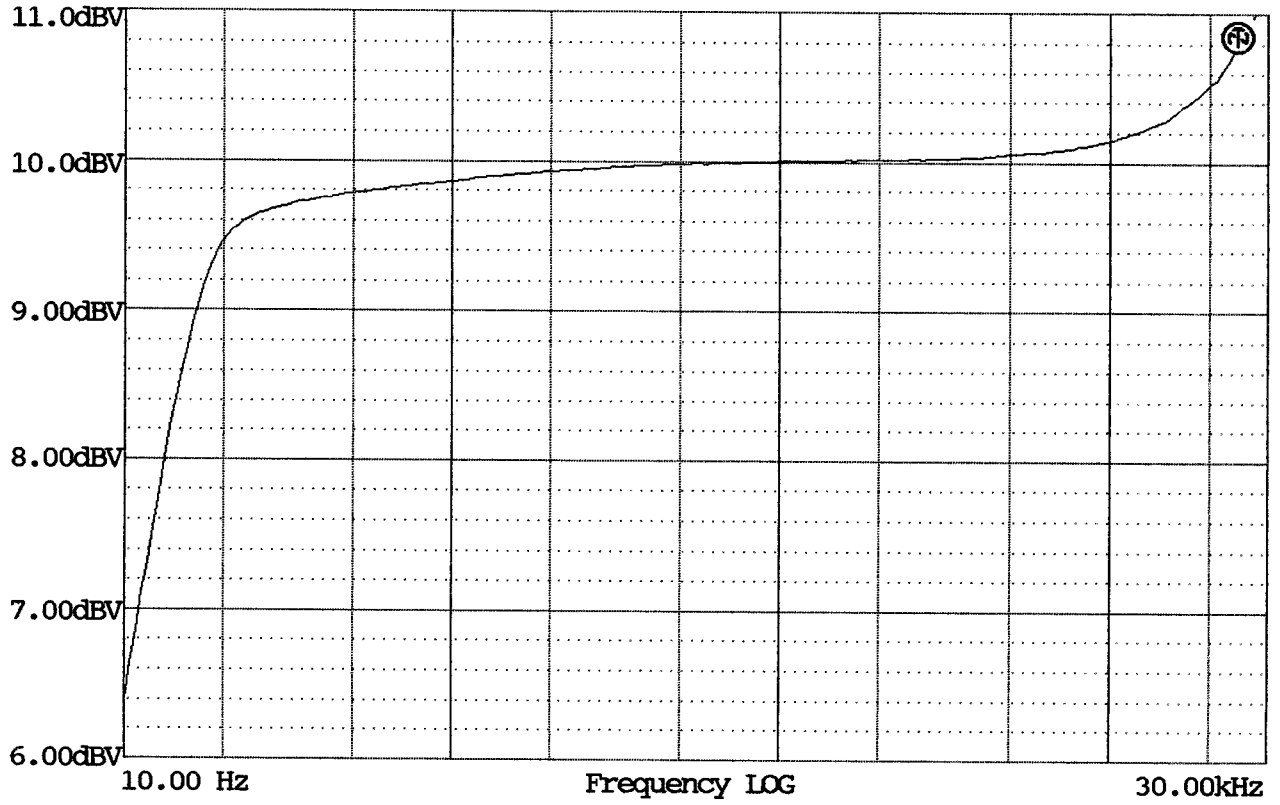


**THD+N**  
03.07.2011  
01:17:24

Output: Analog  
Imp: 200Ohm  
Sine  
10.0dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

A: 9.76dBV 39.99 Hz

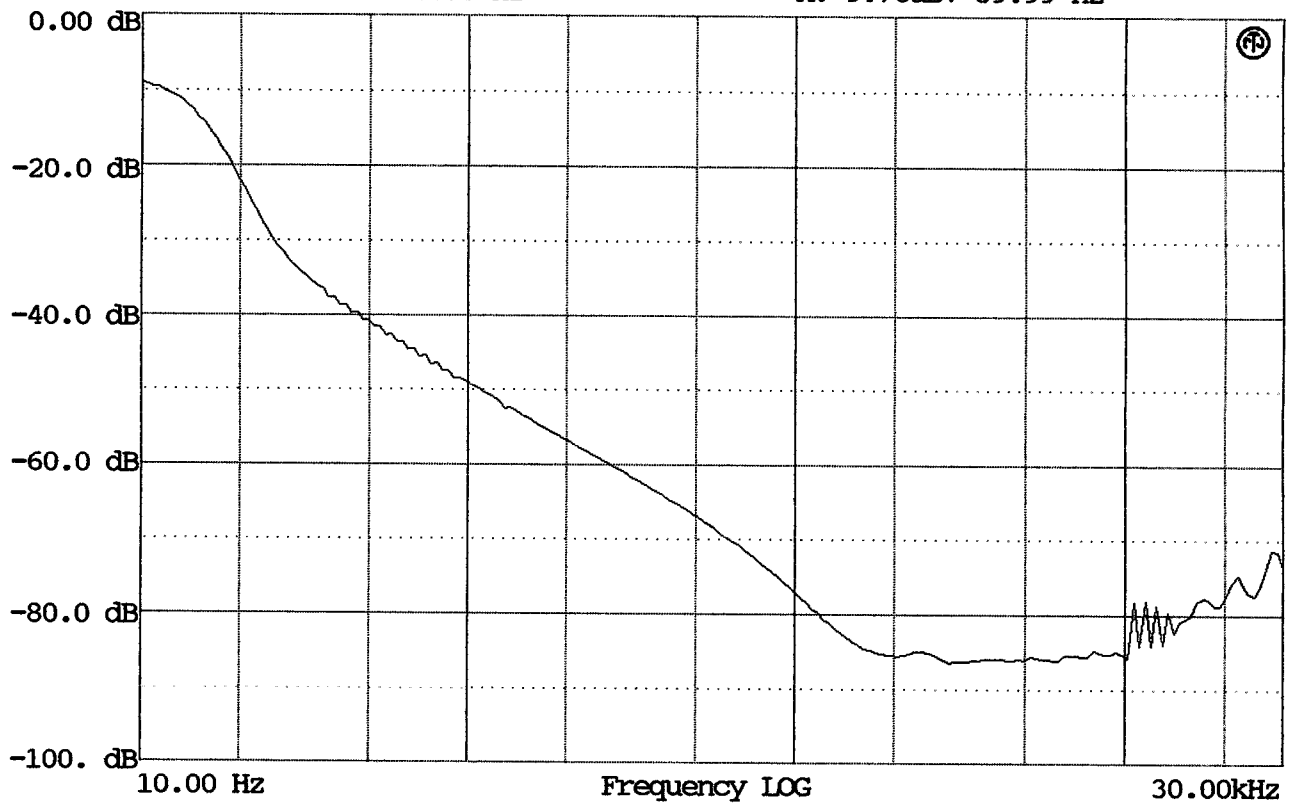


THD+N  
03.07.2011  
02:17:14

Output: Analog  
Imp: <150hm  
Sine  
10.0dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
Off

A: 9.97dBV 39.99 Hz

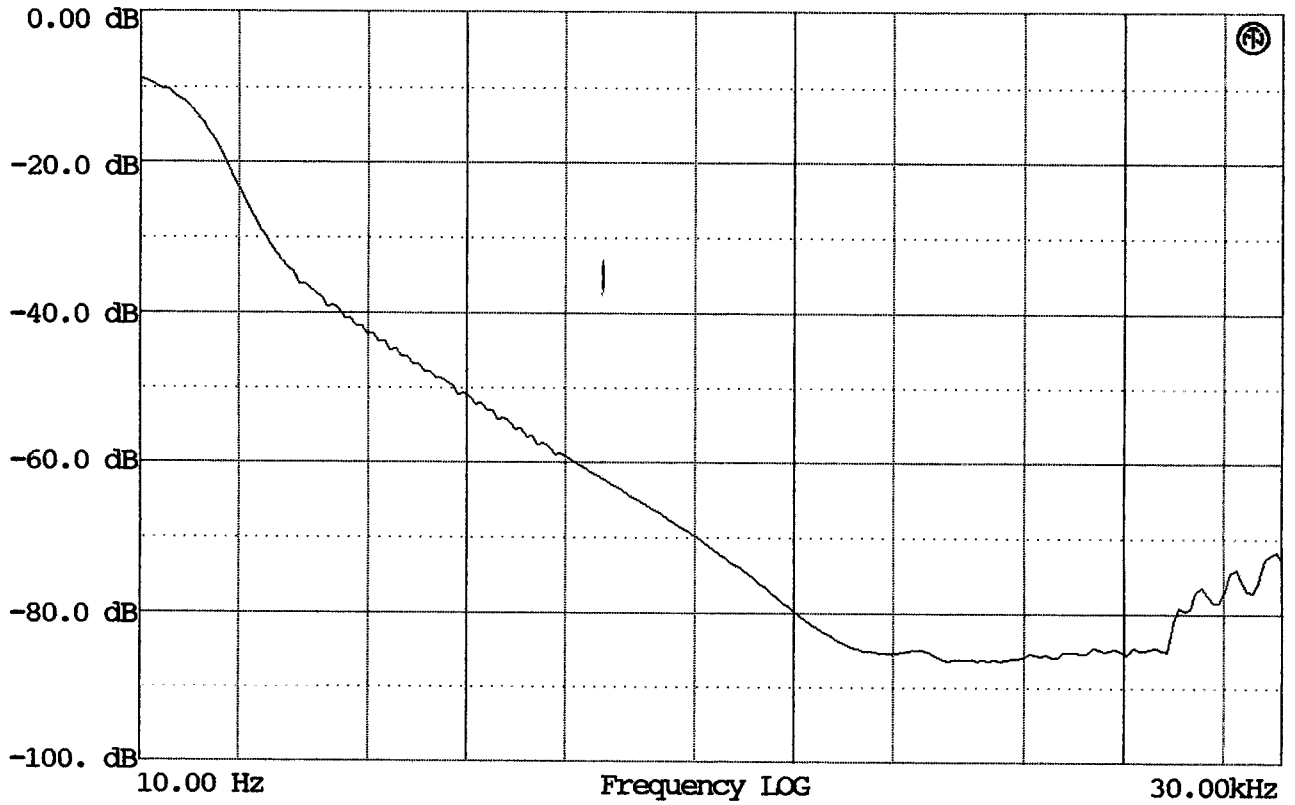


THD+N  
03.07.2011  
02:27:07

Output: Analog  
Imp: <150hm  
Sine  
-20.0dBV 40.00 Hz

Input: Analog  
Imp:100kOhm

Filter:  
AUDIOBP

A: -20.2dBV 39.99 Hz

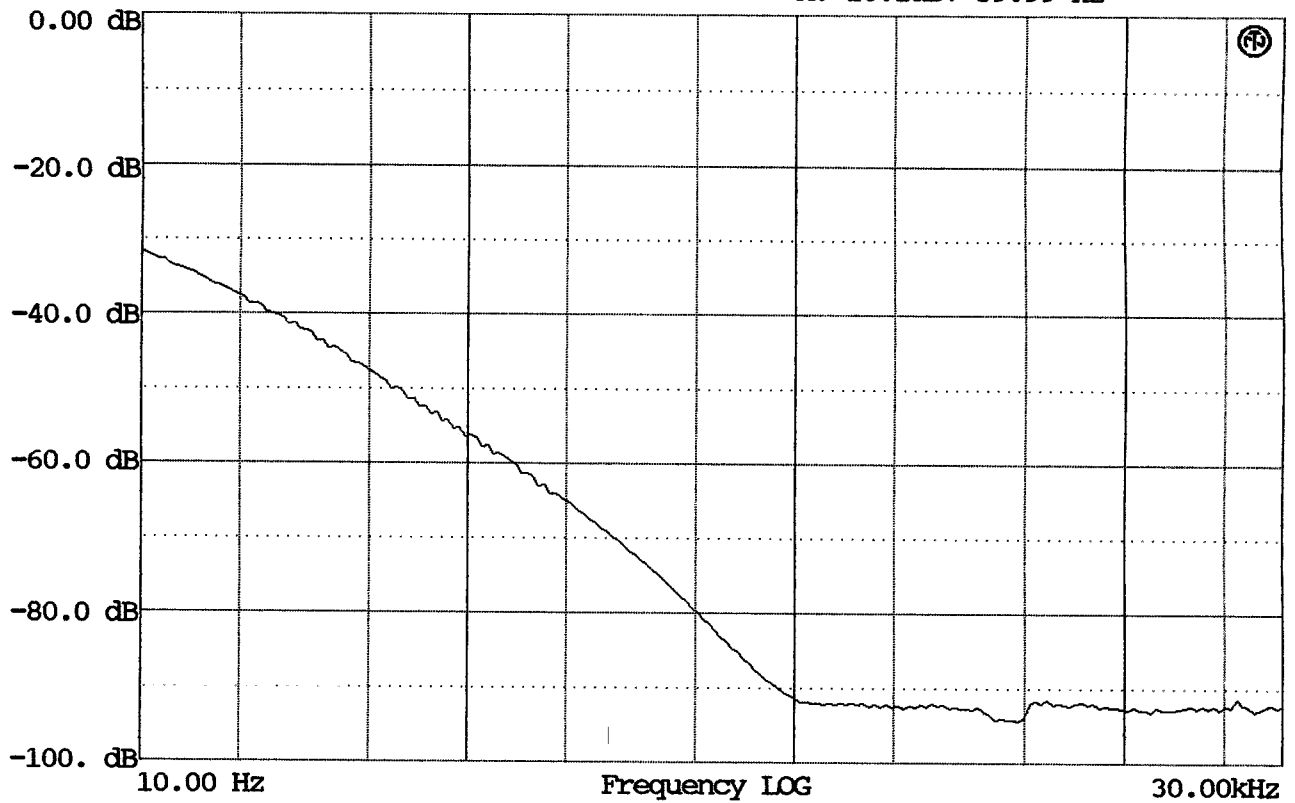

TOA IT-421


**LEVEL**  
03.07.2011  
01:31:43

Output: Analog  
Imp: 200Ohm  
Sine  
20.0dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

A: 18.8dBV 39.99 Hz

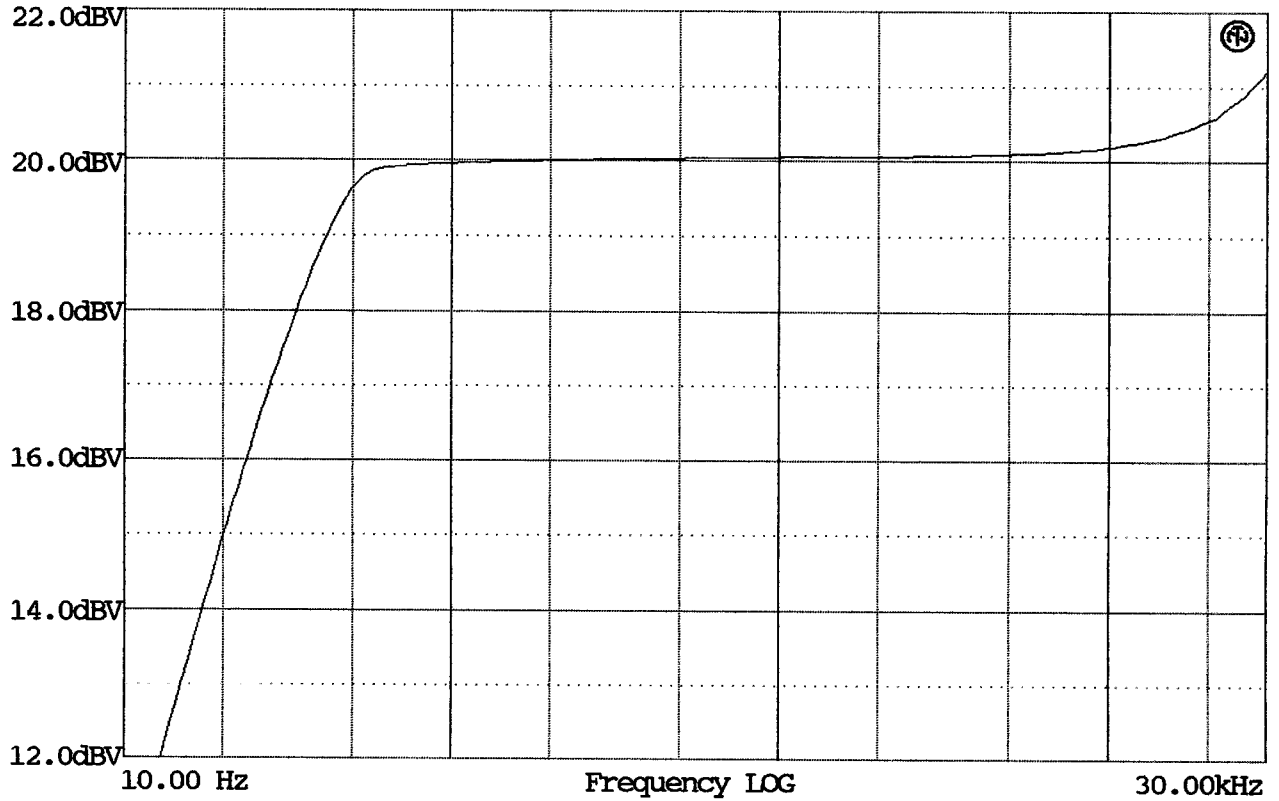

**THD+N**  
03.07.2011  
01:52:42

Output: Analog  
Imp: 200Ohm  
Sine  
20.0dBV 40.00 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

A: 18.8dBV 39.99 Hz

