


**LEVEL**  
24.10.2009  
17:03:28

Output: Analog  
Imp: 600Ohm  
Sine  
0.01dBV 250.0 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

A: -25.4dBV 249.9 Hz

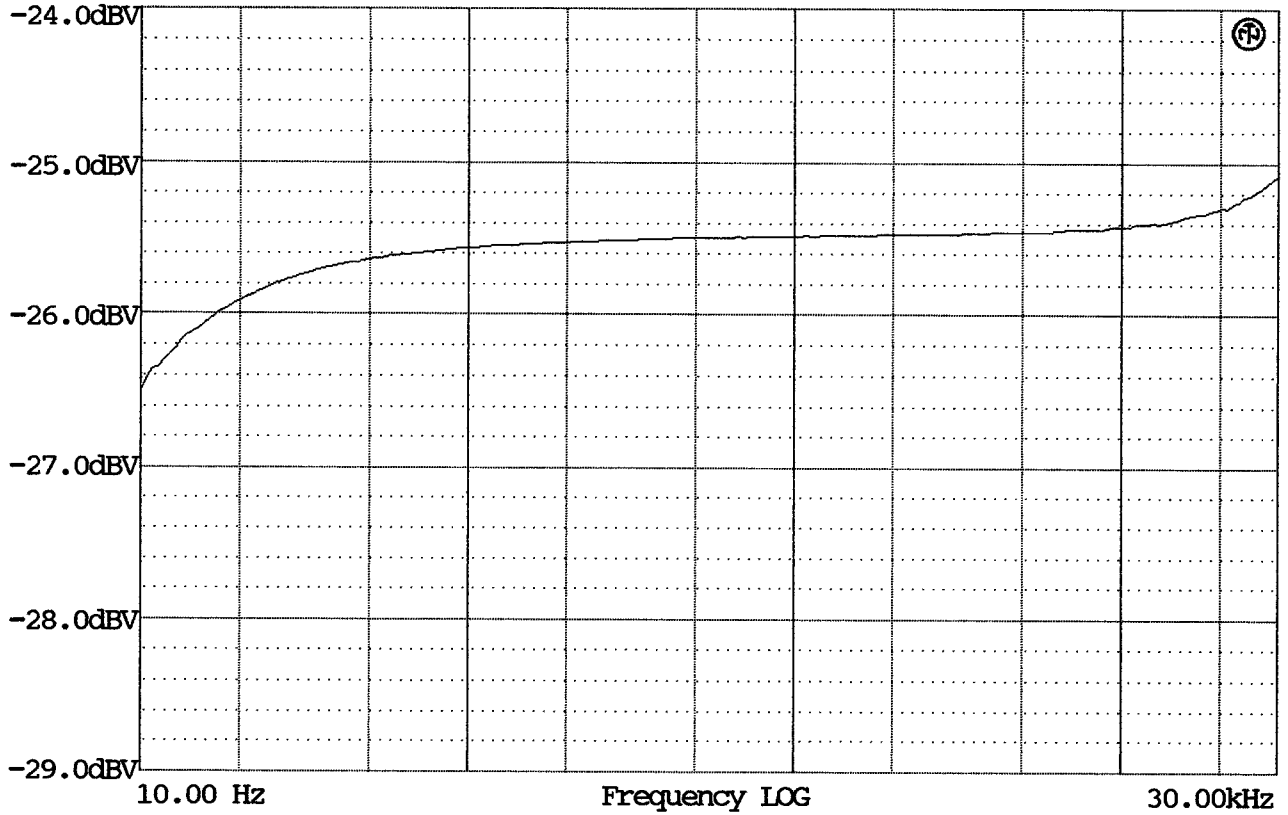


**THD+N**  
24.10.2009  
17:24:41

Output: Analog  
Imp: 600Ohm  
Sine  
0.01dBV 250.0 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

A: -25.4dBV 249.9 Hz

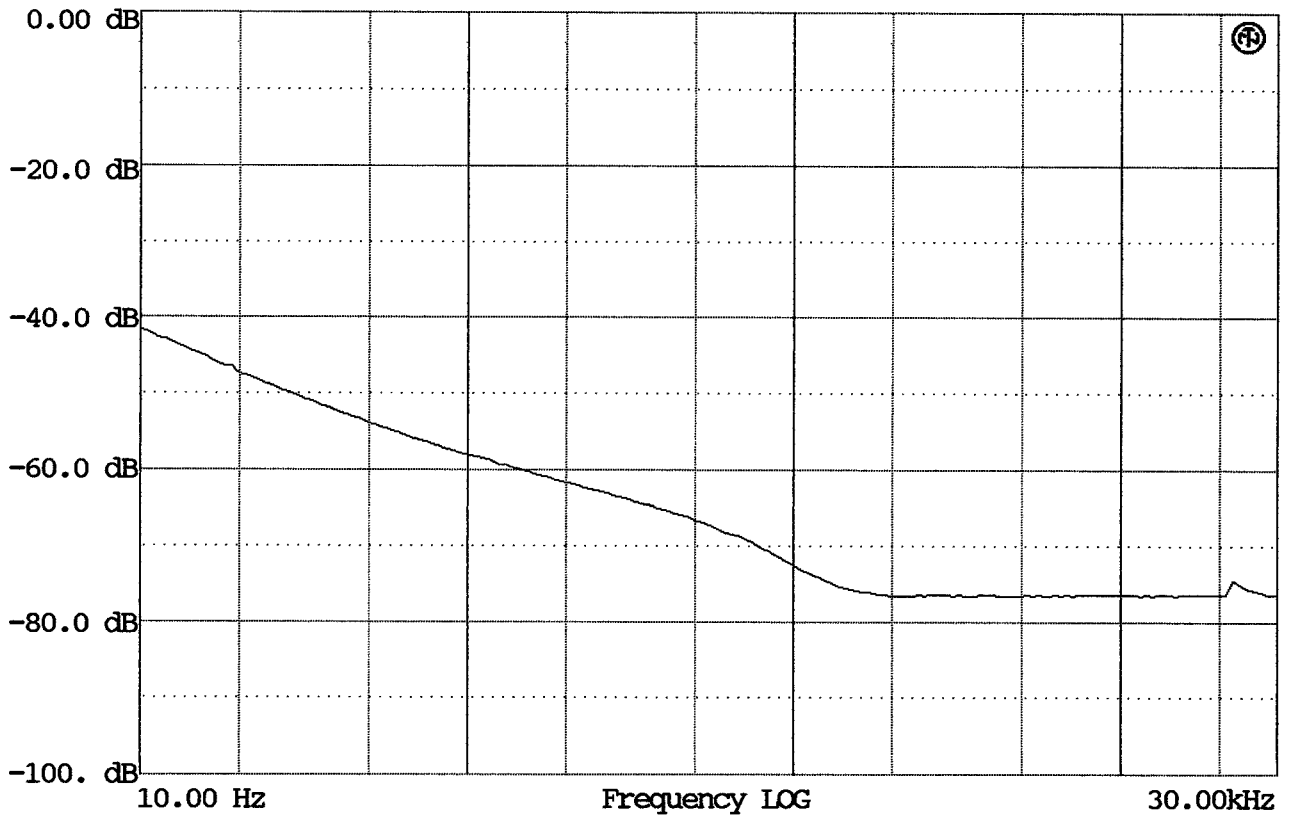

DAP STAGE CURVE 23


**THD+N**  
18.10.2009  
14:14:45

Output: Analog  
Imp: 600Ohm  
Sine  
20.0dBV 250.0 Hz

Input: Analog  
Imp:100kOhm

Filter:  
Off

A: -5.57dBV 249.9 Hz

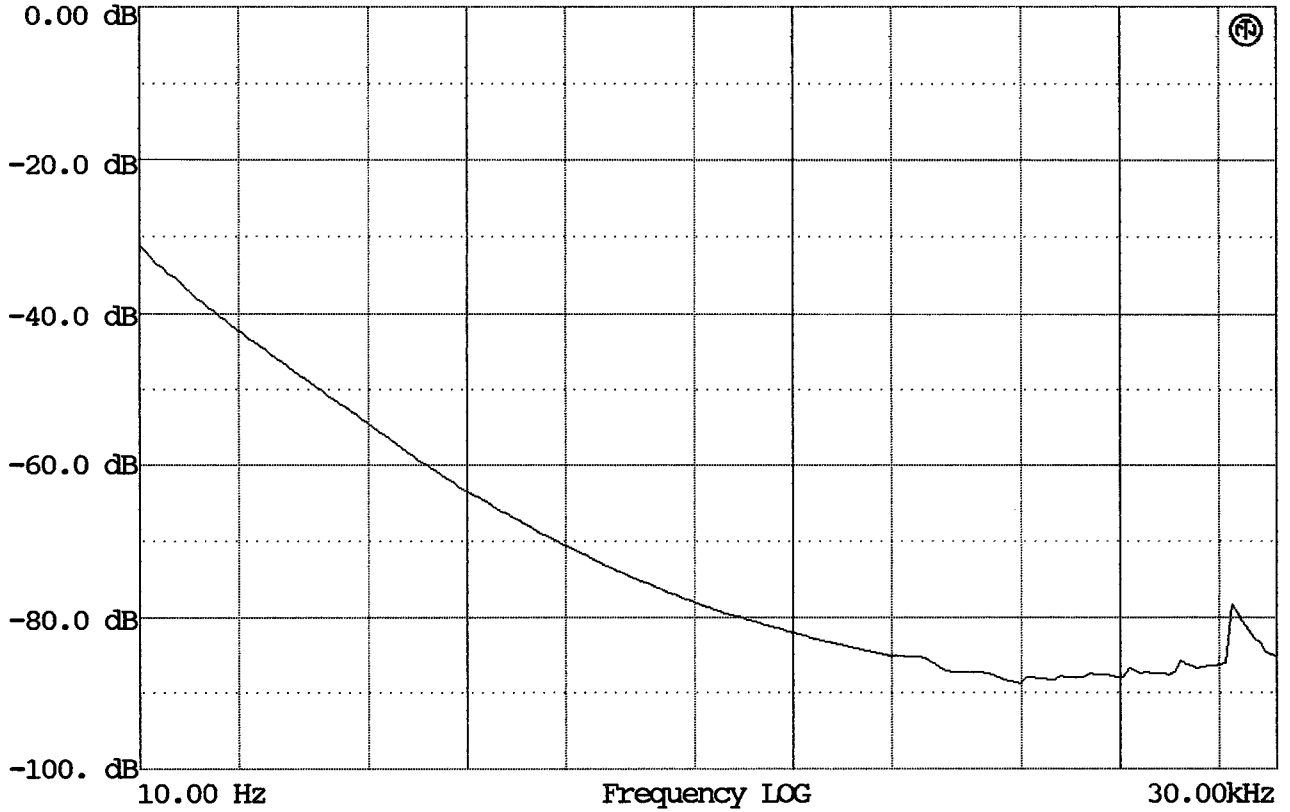

**THD+N**  
18.10.2009  
14:21:17

Output: Analog  
Imp: 600Ohm  
Sine  
26.0dBV 250.0 Hz

Input: Analog  
Imp:100kOhm

Filter:  
Off

A: 0.45dBV 249.9 Hz

