


**LEVEL**  
31.01.2010  
22:02:03

Output: Analog  
Imp: <150hm  
Sine  
-0.00dBV 250.7 Hz

Input: Analog  
Imp:100kOhm  
B:-9.59dBV 250.7 Hz

Filter:  
Off

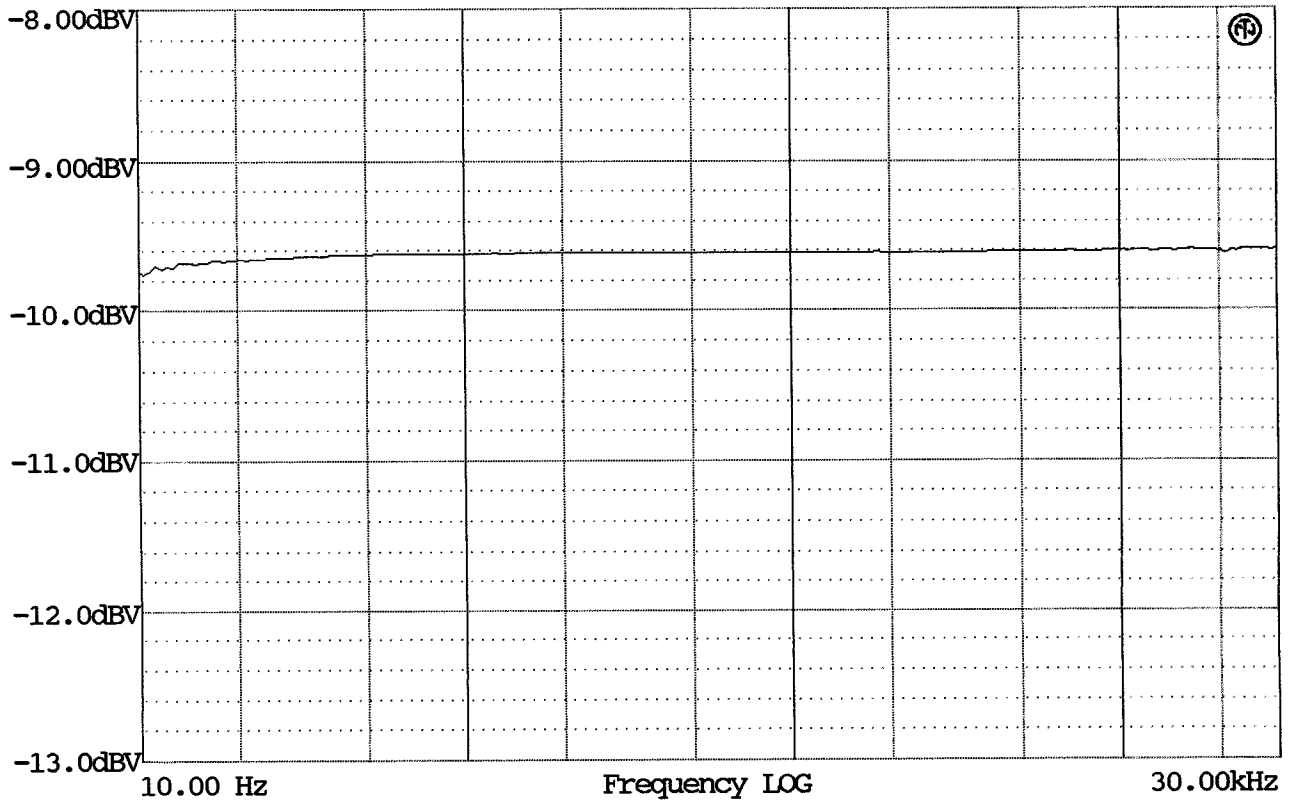


**THD+N**  
31.01.2010  
22:08:38

Output: Analog  
Imp: <150hm  
Sine  
-0.00dBV 250.7 Hz

Input: Analog  
Imp:100kOhm  
B:-9.59dBV 250.7 Hz

Filter:  
Off

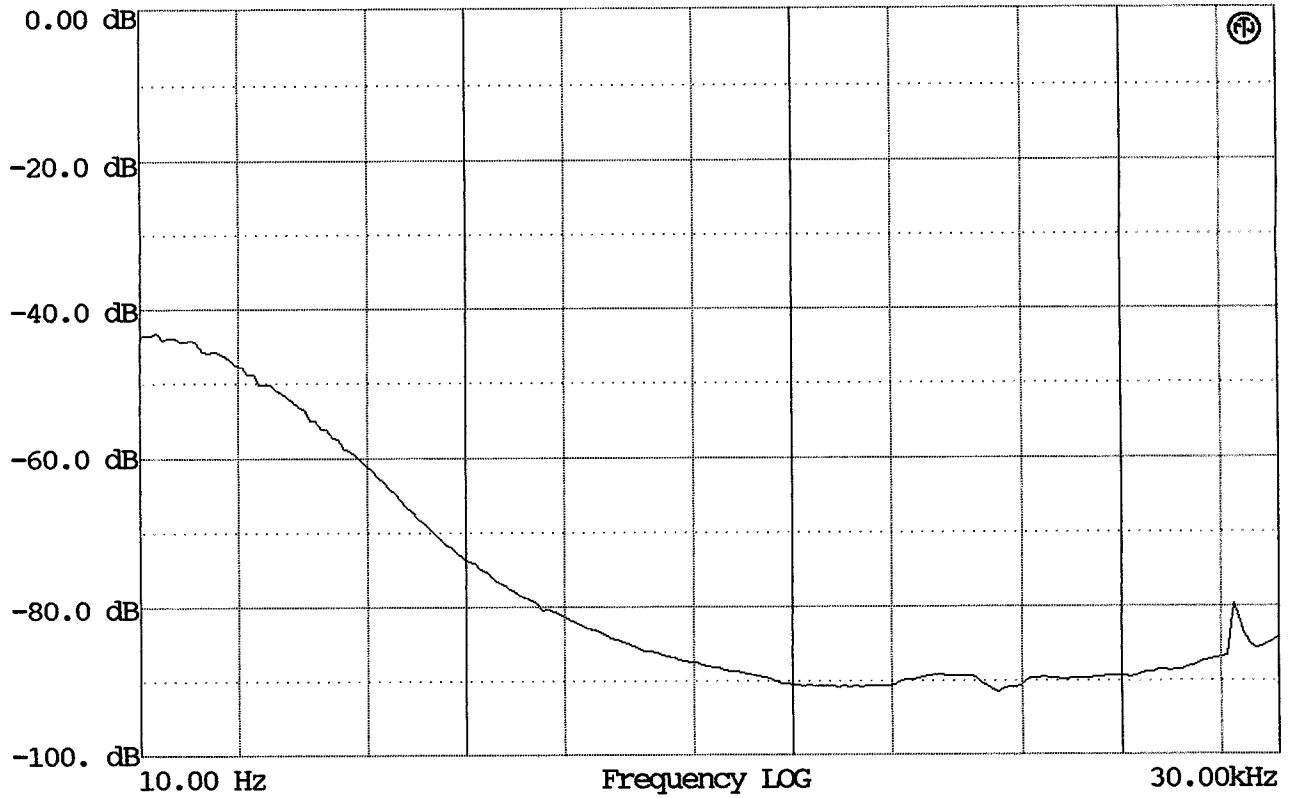


TPA40 XTA 02 400

**LEVEL**  
31.01.2010  
22:10:26

Output: Analog  
Imp: <150hm  
Sine  
10.0dBV 250.7 Hz

Input: Analog  
Imp:100kOhm  
B: 0.39dBV 250.7 Hz

Filter:  
Off

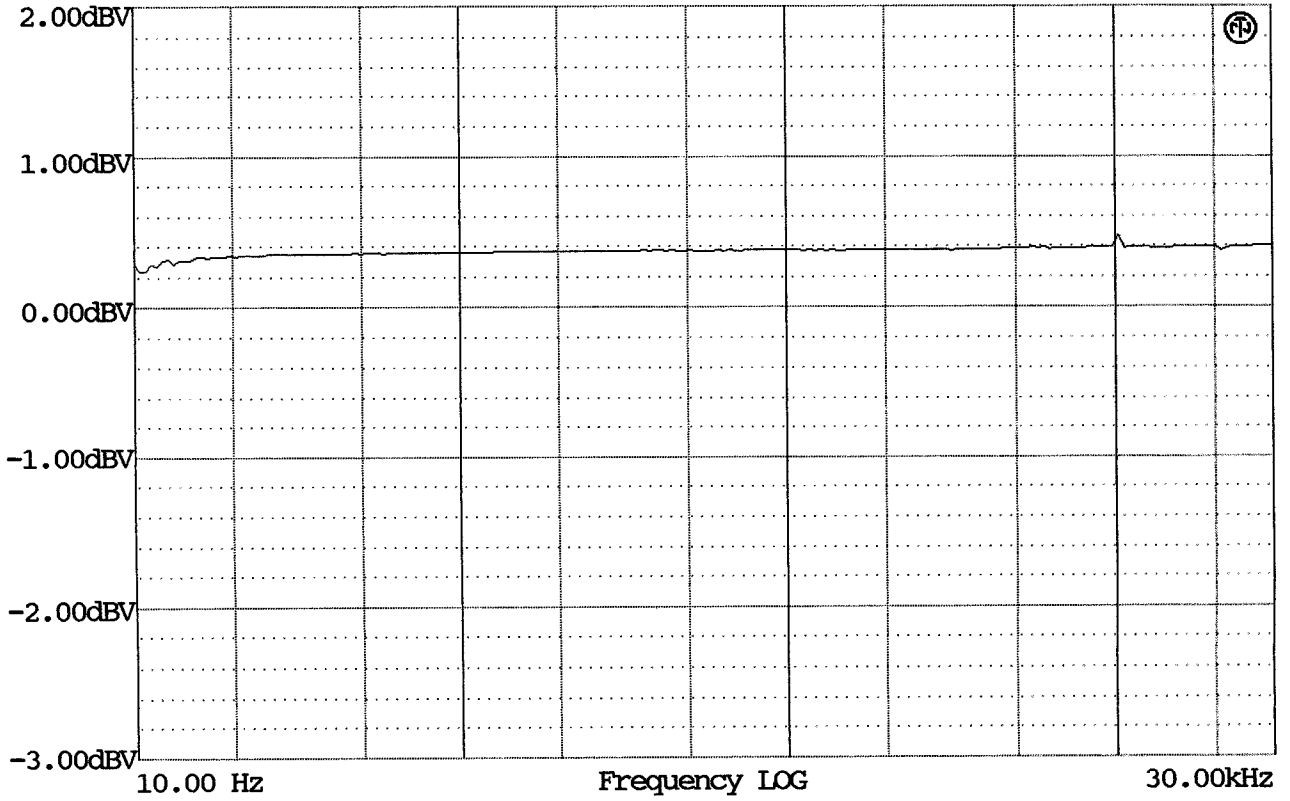


**THD+N**  
31.01.2010  
22:15:48

Output: Analog  
Imp: <150hm  
Sine  
10.0dBV 250.7 Hz

Input: Analog  
Imp:100kOhm  
B: 0.38dBV 250.7 Hz

Filter:  
Off

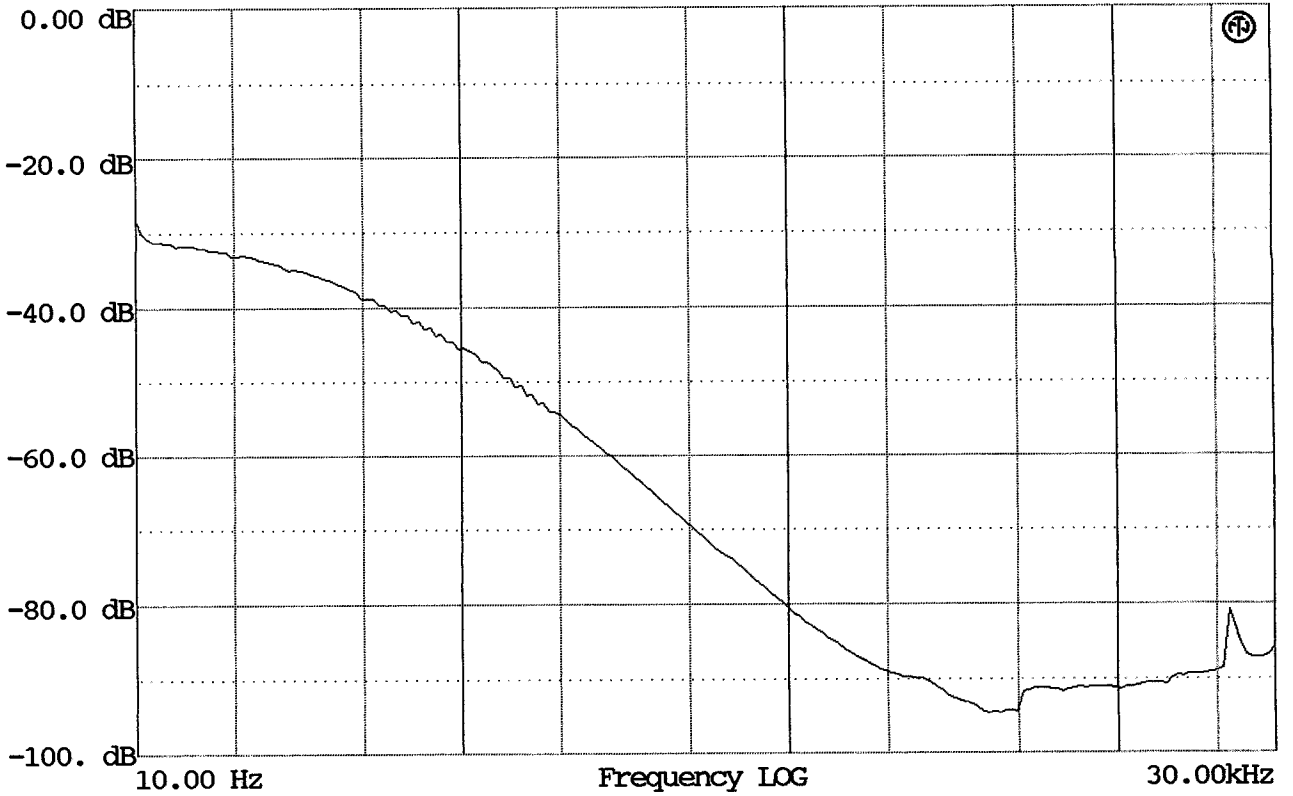

TPA40 & TA NR 400


LEVEL  
31.01.2010  
22:29:51

Output: Analog  
Imp: 200Ohm  
Sine  
10.0dBV 250.7 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

B: 0.24dBV 250.7 Hz

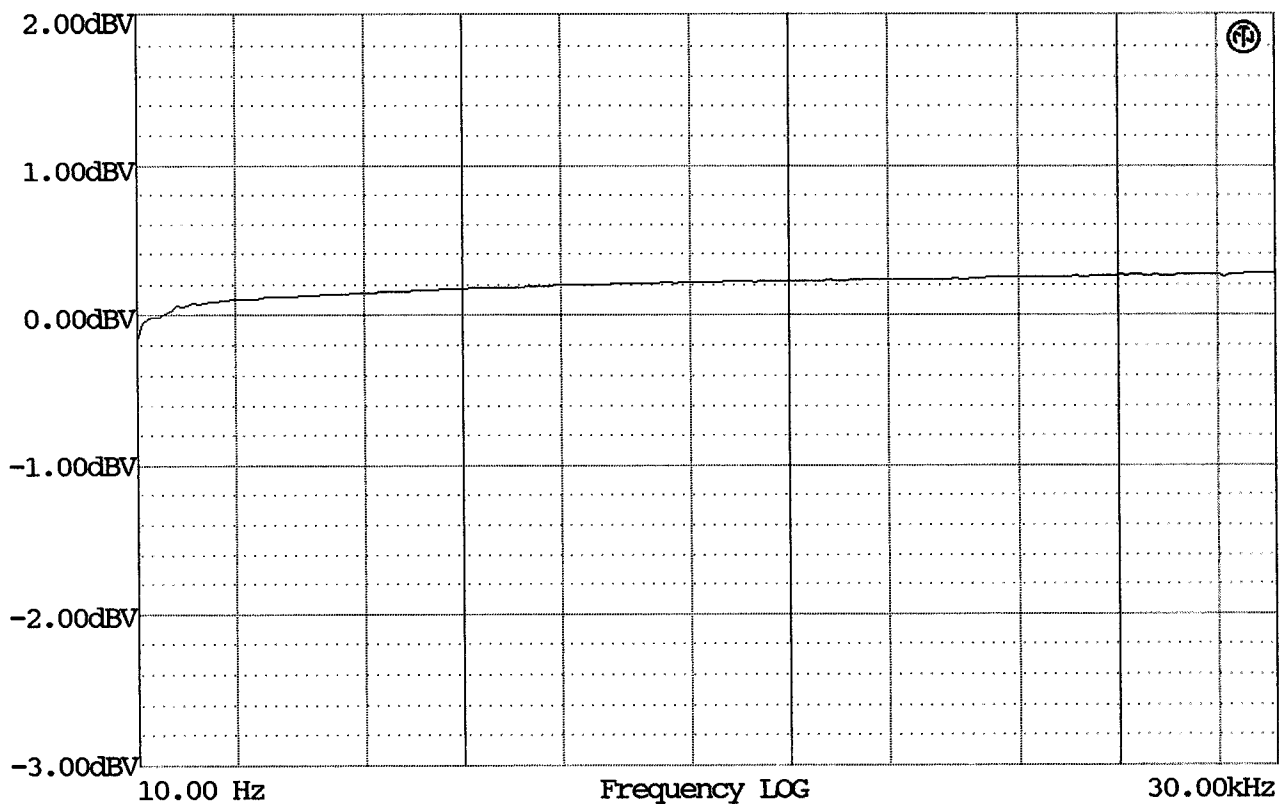


THD+N  
31.01.2010  
22:35:22

Output: Analog  
Imp: 200Ohm  
Sine  
10.0dBV 250.7 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

B: 0.21dBV 250.7 Hz

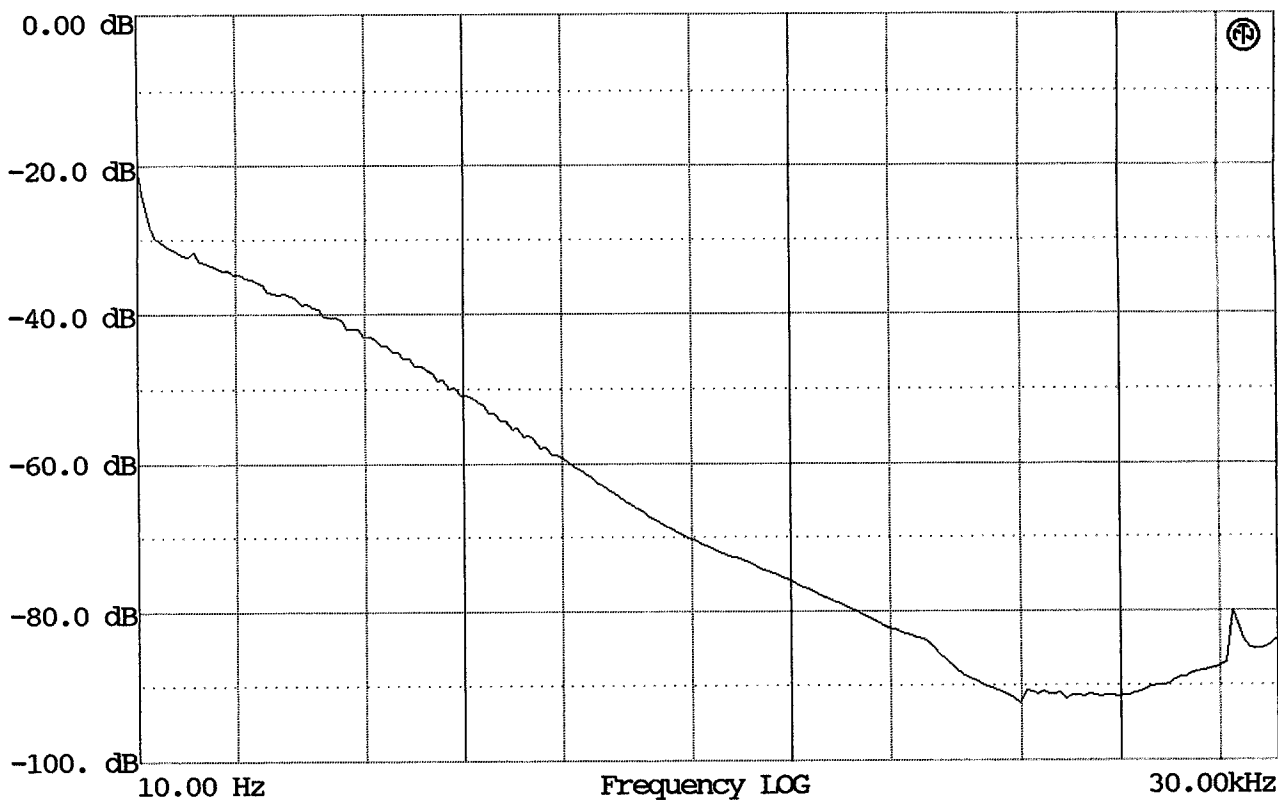


TRAFIXIA DS 400

LEVEL  
31.01.2010  
23:01:02

Output: Analog  
Imp: 600Ohm  
Sine  
10.0dBV 250.7 Hz

Input: Analog  
Imp: 100kOhm  
B: -0.07dBV 250.7 Hz

Filter:  
Off

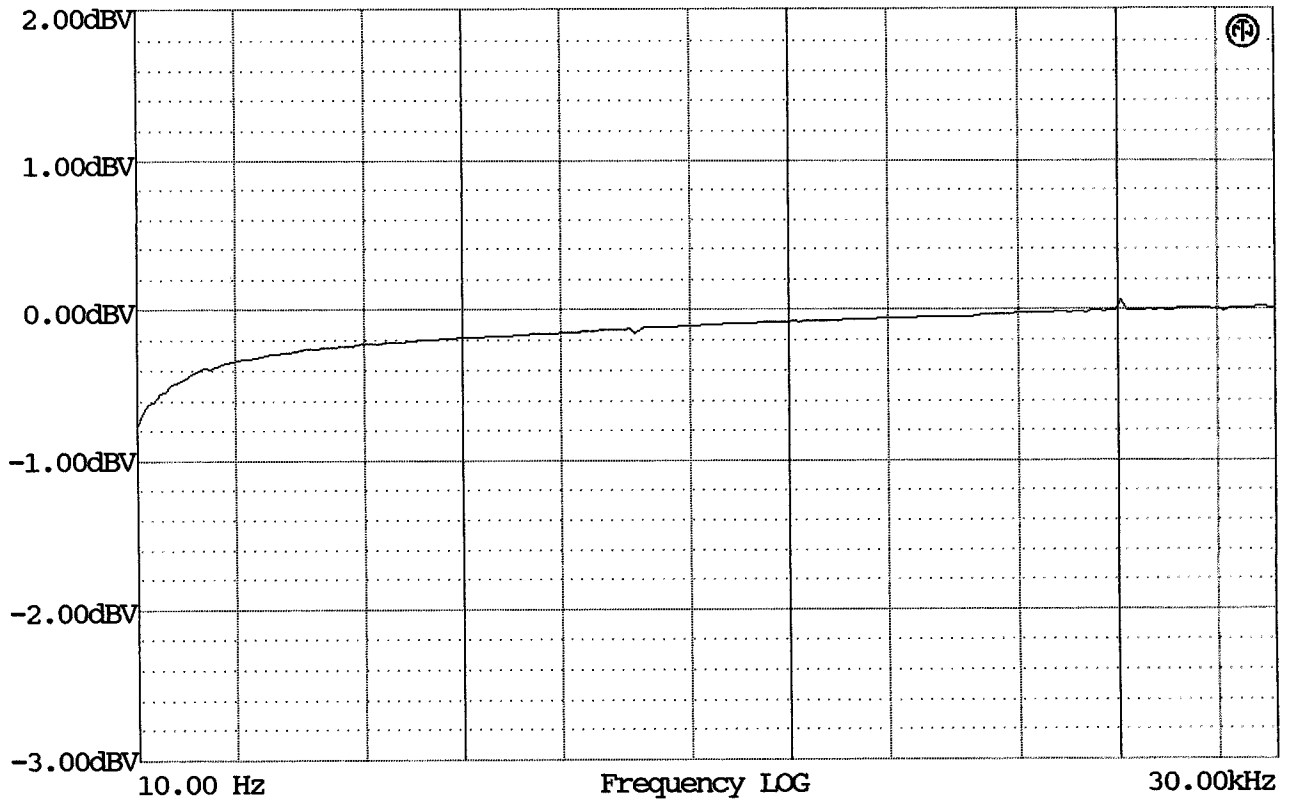


THD+N  
31.01.2010  
23:06:28

Output: Analog  
Imp: 600Ohm  
Sine  
10.0dBV 250.7 Hz

Input: Analog  
Imp: 100kOhm  
B: -0.07dBV 250.7 Hz

Filter:  
Off

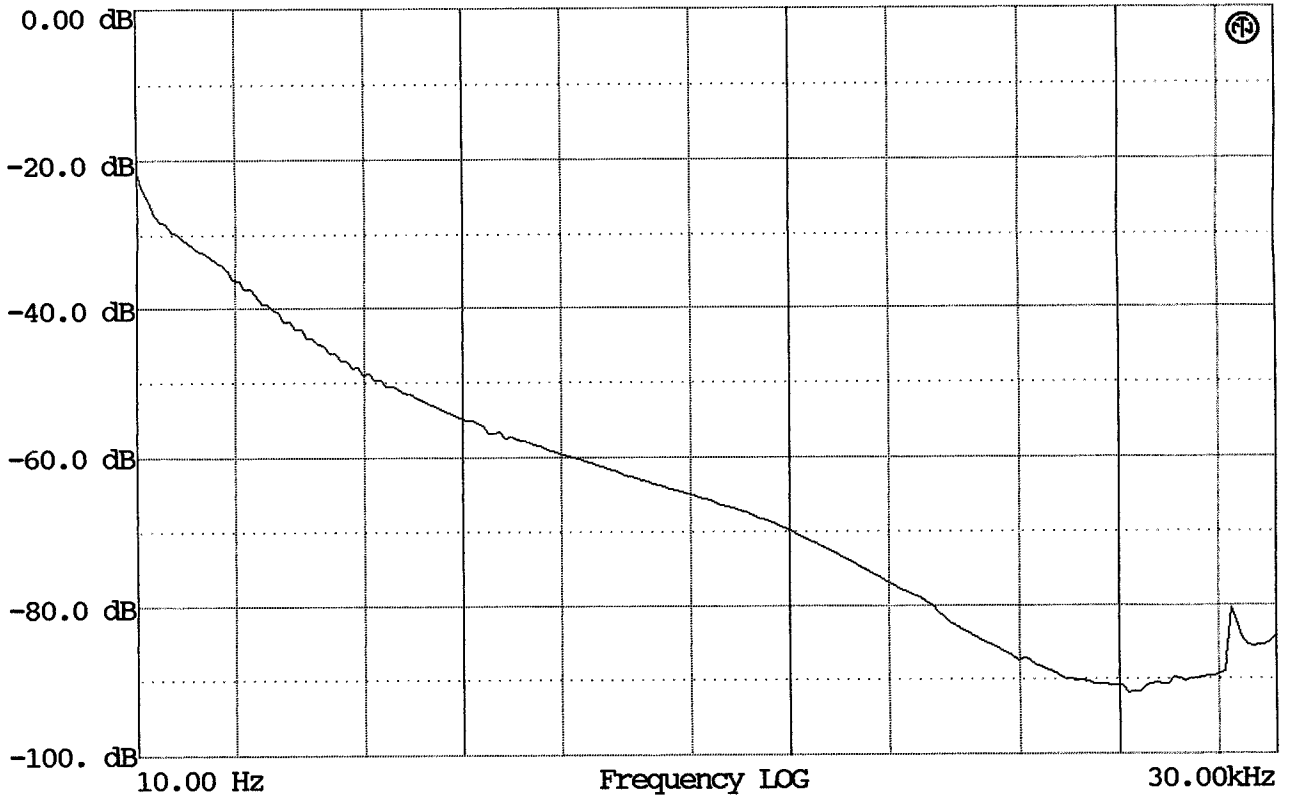

TRAF 57A 02 400


**LEVEL**  
31.01.2010  
22:18:11

Output: Analog  
Imp: <150hm  
Sine  
20.0dBV 250.7 Hz

Input: Analog  
Imp:100kOhm

Filter:  
Off

B: 10.4dBV 250.7 Hz

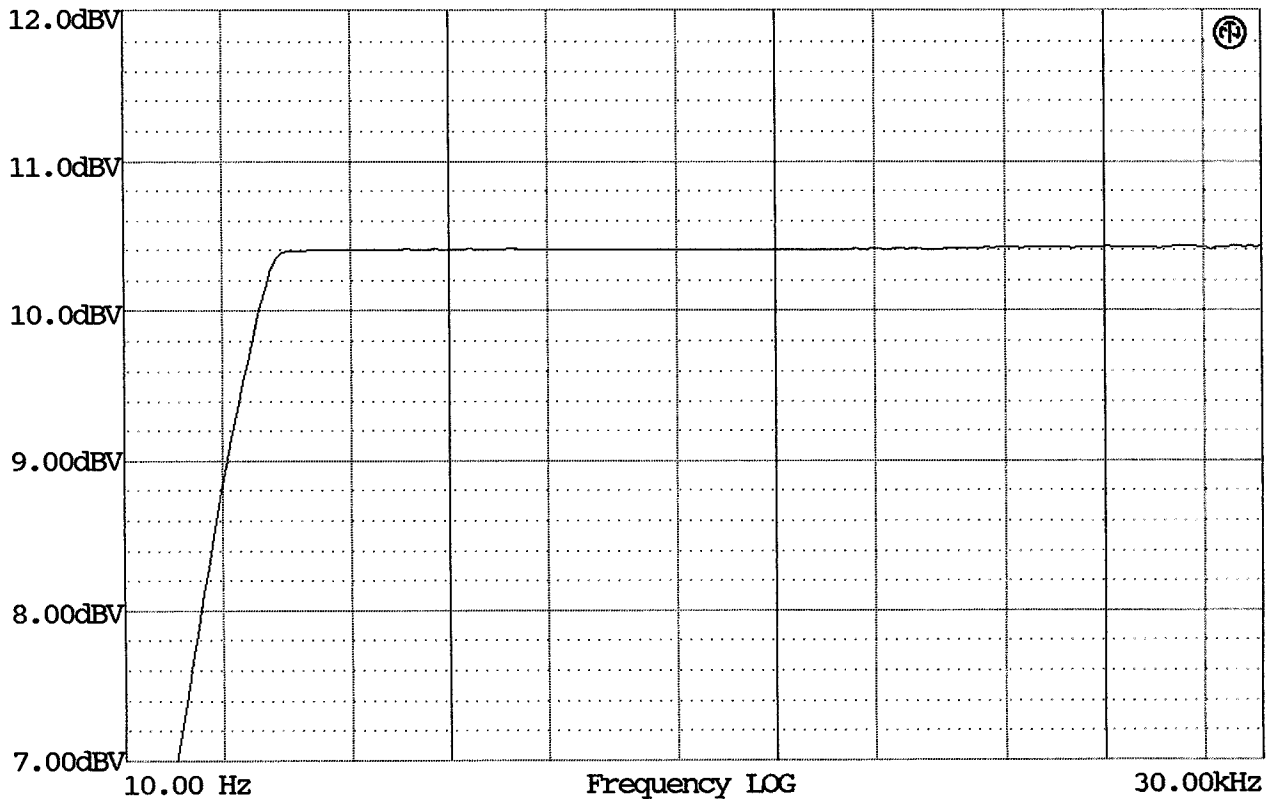


**THD+N**  
31.01.2010  
22:27:57

Output: Analog  
Imp: <150hm  
Sine  
20.0dBV 250.7 Hz

Input: Analog  
Imp:100kOhm

Filter:  
Off

B: 10.4dBV 250.7 Hz

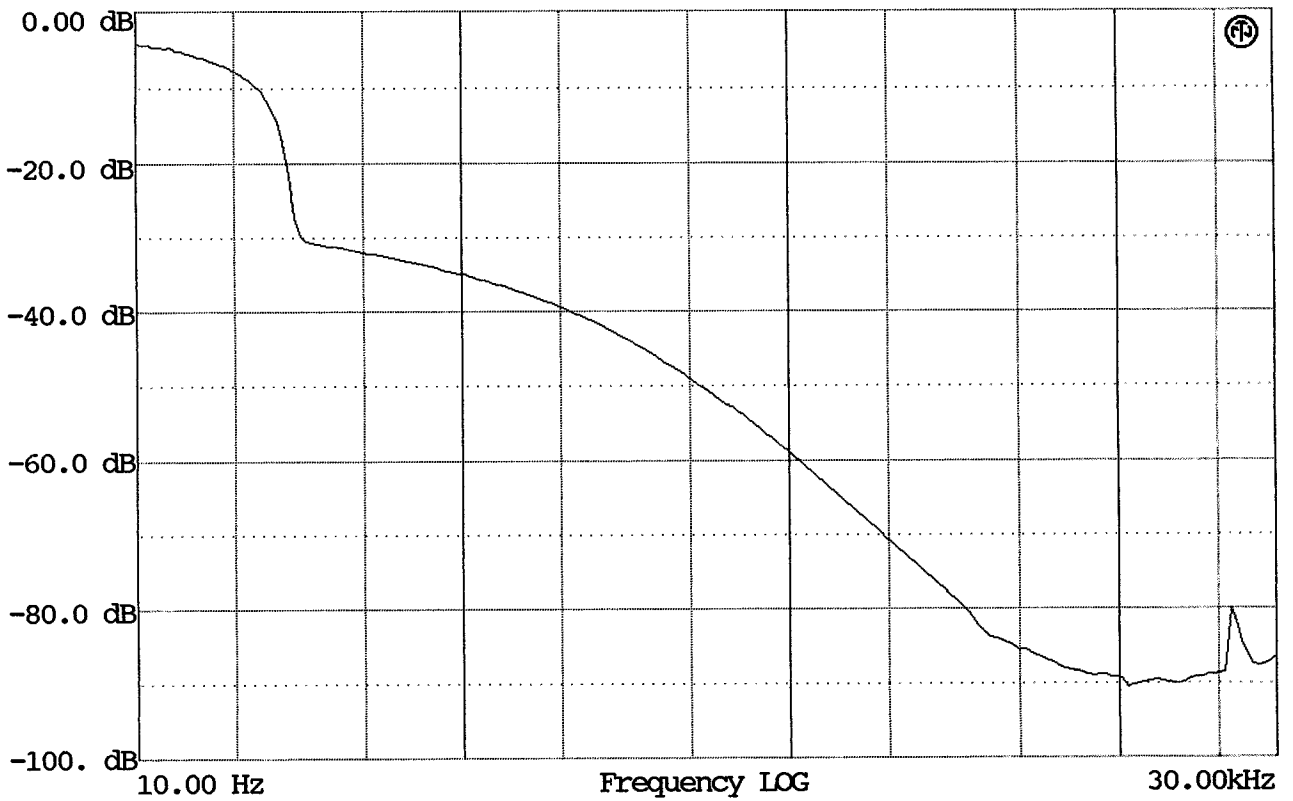


LEVEL  
31.01.2010  
23:11:24

Output: Analog  
Imp: 200Ohm  
Sine  
10.0dBV 250.7 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

B: 0.17dBV 250.7 Hz

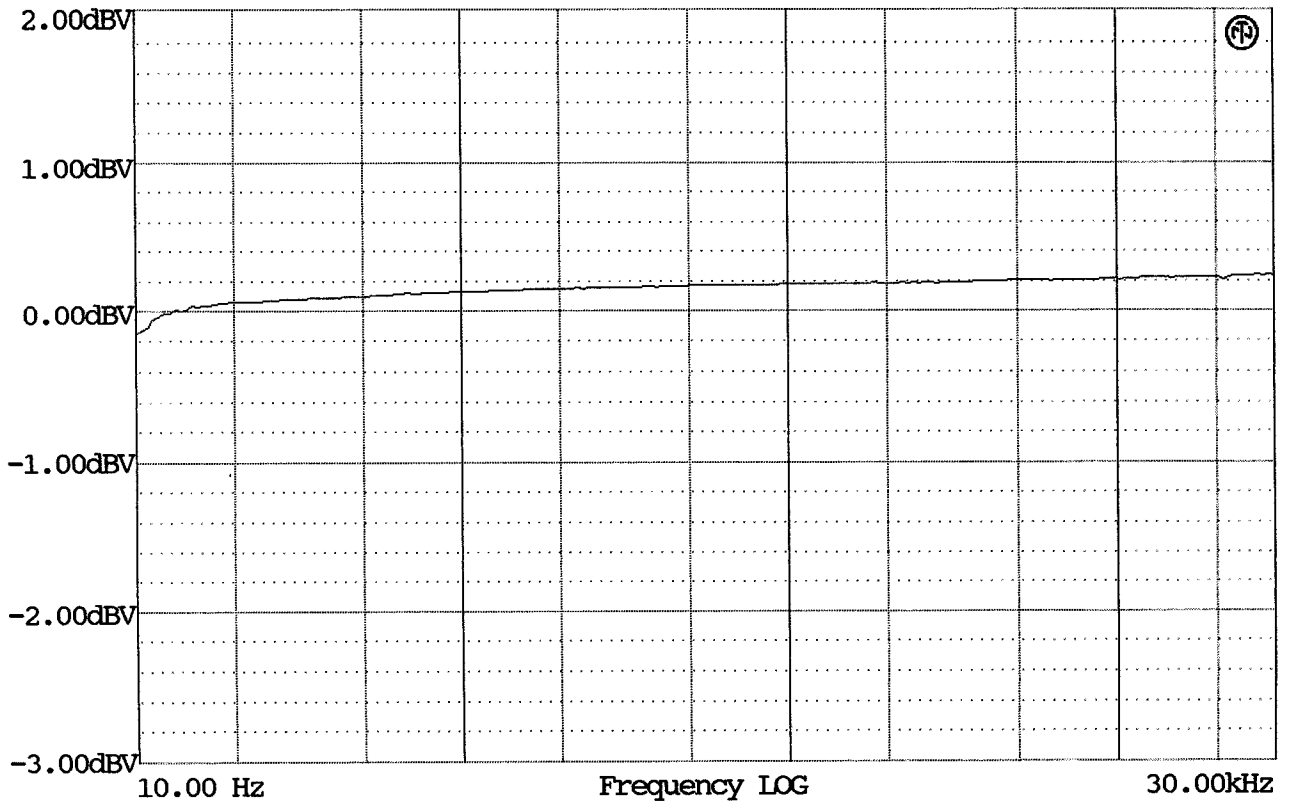


LEVEL  
31.01.2010  
23:13:11

Output: Analog  
Imp: 600Ohm  
Sine  
10.0dBV 250.7 Hz

Input: Analog  
Imp: 100kOhm

Filter:  
Off

B: -0.19dBV 250.7 Hz

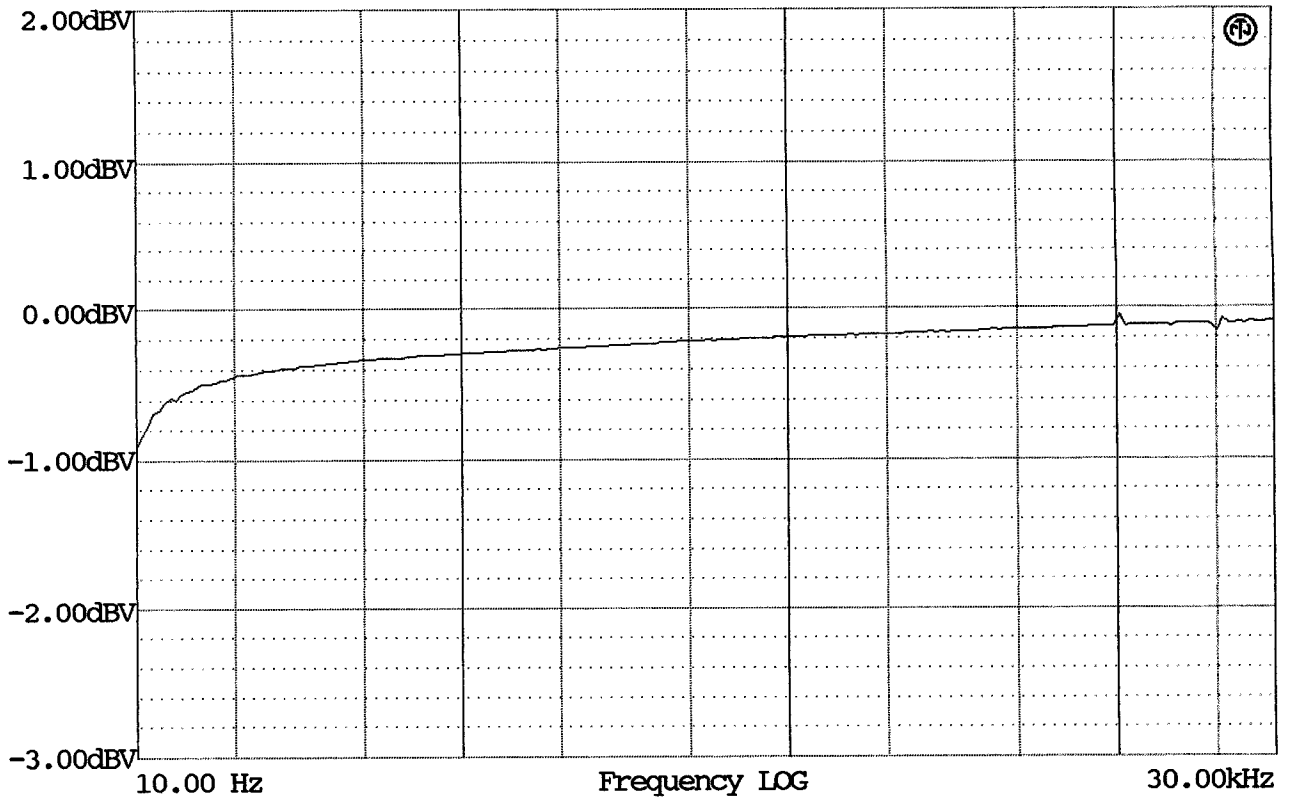

TRAFD STA DS 400 +467/11NR